

RECEIVED

JAN 14 2025

CITY OF KNOXVILLE

BOCK INC.
MONTHLY REPORT FOR
December, 2024

SUBMITTED BY: SB

December, 2024

IEPA SUMMARY

There were no communications with IEPA.

MAINTENANCE SUMMARY

BOCK Inc. performed oil changes on the final clarifiers.

SAFETY

Because safety is an important part of our daily practice, we have been without a loss time injury at the plant for 269 months.

OPERATIONS SUMMARY

Influent flow averaged 242,142 gallons per day.

Electricity used totaled 58,368 kilowatt hours.

Snowfall totaled 0 inches. The melted equivalent of the snowfall as well as any additional rainfall totaled 1.39 inches.




We experienced 0 days of excess flow discharge from outfall A01.

Knoxville, Illinois
Wastewater Treatment Plant
Twelve Month Moving Average Report
Submitted by
Bock Inc.

Date	Influent - Daily Average Flow (gallons per day)	Total Electrical Usage (kilowatt hours)	Total Rainfall (inches)
1 January 2024	534,503	64,896	3.30
2 February 2024	532,862	41,856	0.22
3 March 2024	736,532	39,552	4.86
4 April 2024	995,957	34,944	5.96
5 May 2024	589,558	28,800	2.53
6 June 2024	330,290	26,496	3.20
7 July 2024	657,816	28,792	8.91
8 August 2024	480,132	29,184	4.35
9 September 2024	312,203	31,104	1.46
10 October 2024	179,897	24,960	1.54
11 November 2024	300,413	46,464	3.08
12 December 2024	242,142	58,368	1.39
Total	5,892,305	455,416	40.80
Average	906,508	70,064	3.40

Plant Design Average Flow is
660,000 gallons per day

Plant Design Maximum Flow is
1,650,000 gallons per day

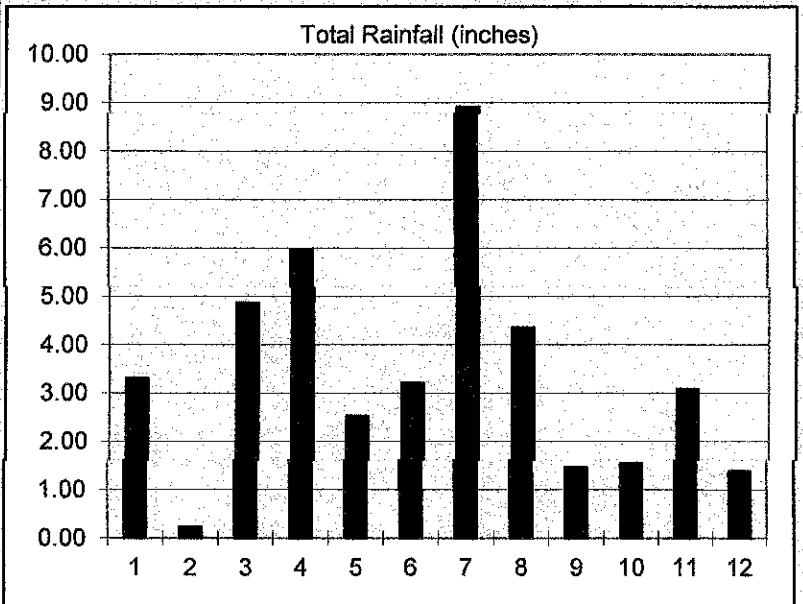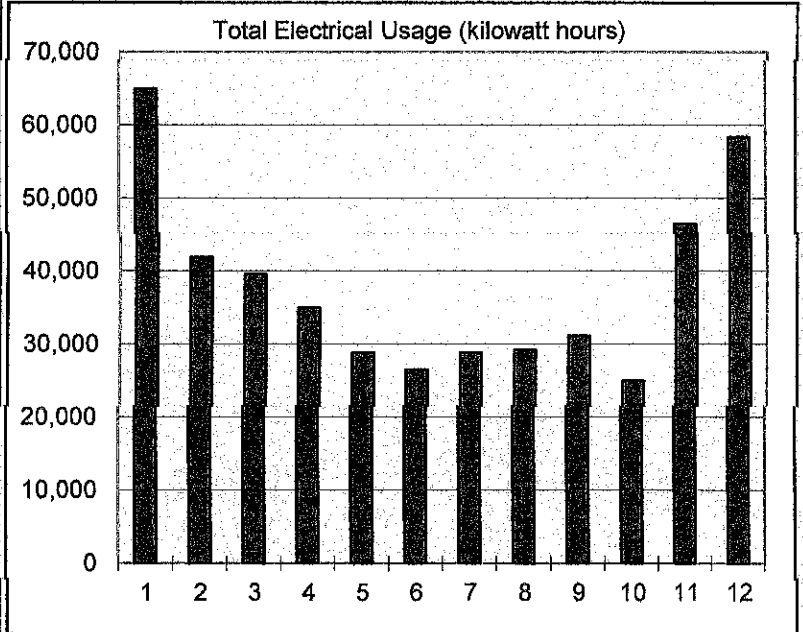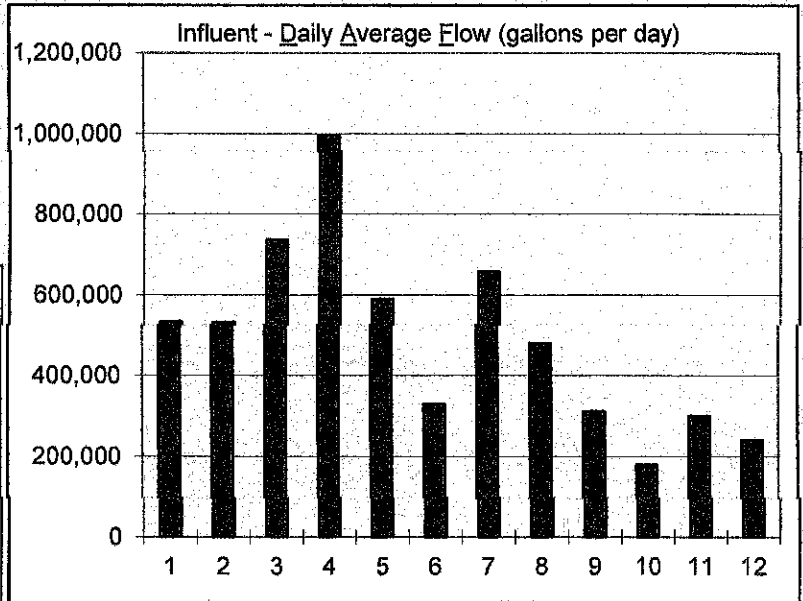

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report December, 2024

Date	Influent Flow (mgd)	RAS Flow (mgd)	WAS Flow (mgd)	Influent TSS (mg/l)	B01 TSS (mg/l)	TSS % Removal (mg/l)	Influent TSS (lbs/day)	B01 TSS (lbs/day)	TSS % Removal (lbs/day)	pH (std. units)	Outfall B01			
											D.O. (mg/l)	NH3 as (N) (mg/l)	NH3 as (N) (lbs/day)	Fecal Coliform (cfu/100)
12/1/2024	0.131600	0.039500	0.000000											
12/2/2024	0.144400	0.043300	0.008840											
12/3/2024	0.141800	0.042500	0.008840											
12/4/2024	0.151100	0.053000	0.008840											
12/5/2024	0.134200	0.050300	0.000000							7.53	9.03	0.100	0.1	
12/6/2024	0.152300	0.045700	0.008840	188.0	6.8	96.4	239	8.6	96.4					
12/7/2024	0.188000	0.066400	0.000000											
12/8/2024	0.191900	0.057600	0.000000											
12/9/2024	0.167200	0.050200	0.000000											
12/10/2024	0.201800	0.060500	0.008840											
12/11/2024	0.171800	0.051500	0.000000											
12/12/2024	0.109400	0.032800	0.000000							7.46	9.22	0.100	0.1	
12/13/2024	0.144900	0.043500	0.000000	94.0	12.6	86.6	114	15.2	86.6					
12/14/2024	0.675100	0.202500	0.000000											
12/15/2024	0.326500	0.098000	0.008840											
12/16/2024	0.278600	0.083600	0.000000											
12/17/2024	0.250500	0.075200	0.008840											
12/18/2024	0.224400	0.067300	0.008840											
12/19/2024	0.233100	0.069900	0.008840											
12/20/2024	0.206200	0.061800	0.000000											
12/21/2024	0.198200	0.059500	0.000000											
12/22/2024	0.221600	0.066500	0.000000											
12/23/2024	0.214400	0.064300	0.000000											
12/24/2024	0.199600	0.059900	0.000000											
12/25/2024	0.177000	0.053100	0.000000											
12/26/2024	0.240000	0.072000	0.008840											
12/27/2024	0.384700	0.115400	0.000000											
12/28/2024	0.342100	0.102600	0.000000											
12/29/2024	0.254900	0.076500	0.000000											
12/30/2024	0.473300	0.142000	0.000000											
12/31/2024	0.575800	0.172700	0.000000											
Minimum	0.109400	0.032800	0.000000	94.0	6.8	86.6	114	8.6	86.6	7.46	9.03	<0.100	0.1	
Maximum	0.675100	0.202500	0.008840	188.0	12.6	96.4	239	15.2	96.4	7.53	9.22	<0.100	0.1	
Total	7.506400	2.269600	0.088400	282	19.4	183	352	23.9	183	15.0	18.3	0.200	0.2	
Average	0.242142	0.073213	0.002852	141.0	9.7	91.5	176	11.9	91.5	7.50	9.13	0.100	0.1	

Knoxville, Illinois Wastewater Treatment Plant

Operated by Bock Inc.

Monthly Report for December, 2024

Date	Influent BOD (mg/l)	B01 CBOD (mg/l)	BOD % Removal (mg/l)	Influent BOD (lbs/day)	B01 CBOD (lbs/day)	BOD % Removal (lbs/day)	Electrical Usage (kwh's)	High Temperature (degrees F)	Low Temperature (degrees F)	Rainfall (inches)	Snowfall (inches)
12/1/2024							1,536	27.5	12.1		
12/2/2024							1,920	27.5	10.2		
12/3/2024							2,304	31.9	18.6		
12/4/2024							2,688	41.5	8.5		
12/5/2024	220	<4.00	98.2	246	4.5	98.2	1,920	22.8	9.9		
12/6/2024							1,536	38.0	19.1		
12/7/2024							1,536	53.2	38.1		
12/8/2024							1,152	59.7	37.5		
12/9/2024							1,536	53.0	27.7		
12/10/2024							1,920	35.3	28.2		
12/11/2024							2,688	35.3	6.5		
12/12/2024	120.0	<4.00	96.7	109	3.6	96.7	1,536	12.8	8.0		
12/13/2024							2,688	28.2	8.9	0.03	
12/14/2024							2,304	39.9	27.9	0.29	
12/15/2024							1,536	45.6	35.6	0.01	
12/16/2024							1,920	47.1	30.7		
12/17/2024							1,536	42.1	30.7		
12/18/2024							1,920	35.2	24.3		
12/19/2024							1,920	38.3	24.9		
12/20/2024							2,304	29.7	15.5		
12/21/2024							1,536	31.0	20.3		
12/22/2024							1,920	39.1	22.6		
12/23/2024							1,536	48.2	28.2		
12/24/2024							1,920	36.0	33.6		
12/25/2024							2,304	41.3	34.4	0.01	
12/26/2024							1,536	47.3	41.3	0.06	
12/27/2024							1,920	49.5	44.7	0.31	
12/28/2024							1,920	48.0	39.4		
12/29/2024							1,920	45.7	36.0		
12/30/2024							1,536	43.8	34.8	0.63	
12/31/2024							1,920	36.7	36.7	0.05	
Minimum	120.0	<4.00	96.7	109	3.6	96.7	1,152	12.8	6.5	0.01	0.0
Maximum	220.0	<4.00	98.2	246	4.5	98.2	2,688	59.7	44.7	0.63	0.0
Total	340.0	8.00	194.8	356	8.1	194.8	58,368	1,211	795	1.39	0.0
Average	170.0	4.00	97.5	178	4.1	97.5	1,883	39.1	25.6	0.17	0.0

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report for Decmeber, 2024
 Outfall A01
 Excess Flow Discharge

Date	BOD (mg/l)	TSS (mg/l)	NH3 (as N) (mg/l)	Fecal Coliform (cfu's/100ml)	Flow (mgd)
12/1/2024					0.000000
12/2/2024					0.000000
12/3/2024					0.000000
12/4/2024					0.000000
12/5/2024					0.000000
12/6/2024					0.000000
12/7/2024					0.000000
12/8/2024					0.000000
12/9/2024					0.000000
12/10/2024					0.000000
12/11/2024					0.000000
12/12/2024					0.000000
12/13/2024					0.000000
12/14/2024					0.000000
12/15/2024					0.000000
12/16/2024					0.000000
12/17/2024					0.000000
12/18/2024					0.000000
12/19/2024					0.000000
12/20/2024					0.000000
12/21/2024					0.000000
12/22/2024					0.000000
12/23/2024					0.000000
12/24/2024					0.000000
12/25/2024					0.000000
12/26/2024					0.000000
12/27/2024					0.000000
12/28/2024					0.000000
12/29/2024					0.000000
12/30/2024					0.000000
12/31/2024					0.000000
Minimum					0.000000
Maximum					0.000000
Total					0.000000
Average					0.000000

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report for December, 2024
 Outfall 001
 Excess Flow Discharge

Date	D.O. (mg/L)	BOD (mg/L)	pH (Std.Units)	TSS (mg/L)	NH3 (as N) (mg/L)	CL2 Residual (mg/L)	Flow (mgd)
12/01/24							0.131600
12/02/24							0.144400
12/03/24							0.141800
12/04/24							0.151100
12/05/24							0.134200
12/06/24							0.152300
12/07/24							0.188000
12/08/24							0.191900
12/09/24							0.167200
12/10/24							0.201800
12/11/24							0.171800
12/12/24							0.109400
12/13/24							0.144900
12/14/24							0.675100
12/15/24							0.326500
12/16/24							0.278600
12/17/24							0.250500
12/18/24							0.224400
12/19/24							0.233100
12/20/24							0.206200
12/21/24							0.198200
12/22/24							0.221600
12/23/24							0.214400
12/24/24							0.199600
12/25/24							0.177000
12/26/24							0.240000
12/27/24							0.384700
12/28/24							0.342100
12/29/24							0.254900
12/30/24							0.473300
12/31/24							0.575800
Minimum							0.109400
Maximun							0.675100
Total							7.506400
Average							0.242142

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NPDES eReporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(i)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting burden for this collection of information is estimated to average 2 hours per annual response. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (282211), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit: IL0022209
Permittee: KNOXVILLE, CITY OF
Major: No
33 NORTH SIDE PUBLIC SQUARE
KNOXVILLE, IL 61448
Facility Location: KNOXVILLE STP
507 SOUTH DIVISION STREET
KNOXVILLE, IL 61448
Discharge: 001-0
COMBINED DISCHARGE FROM AQ1 AND B01
Status: NotDMR Validated
Report Dates & Status: External Outfall
Monitoring Period: From 12/01/24 to 12/31/24
Considerations for Form Completion:
BOW ID: W0950300002; NUMBER OF DAYS OF DISCHARGE:
Principal Executive Officer: Stanley Bockwitz
Chief Operator:
Telephone: 309-652-2789
First Name: Stanley
Last Name: Bockwitz
Title: Chief Operator
Form NODI: No Data Indicator (NODI)
Monitoring Location: Season 9 Param NODI

Parameter Name	Monitoring Location	Season	Param. NODI	Sample Permit Rec. Value (NODI)	Sample Permit Rec. Value (NODI)	Quantity or Loading	Qualifier 1	Qualifier 2	Qualifier 3	Value 1	Value 2	Value 3	Units	# of Ex.	Frequency or Analysis	Sample Type
00300 Oxygen, dissolved [DO]	1 - Effluent Gross	0	-	-	-	Req Mon MO AV MIN	C - No Discharge	Req Mon MW WK AV	C - No Discharge	Req Mon DAILY MIN	19 - mg/L	DL/D5 - Daily When Discharging	GR - Grab			
00310 BOD, 5-day, 20 deg. C	1 - Effluent Gross	0	-	-	-	Req Mon MO AVG	C - No Discharge	45.0 Wkly AVG	C - No Discharge	19 - mg/L	DL/D5 - Daily When Discharging	GR - Grab				
00400 pH	1 - Effluent Gross	0	-	-	-	Req Mon MO AVG	C - No Discharge	45.0 Wkly AVG	C - No Discharge	12 - SU	DL/D5 - Daily When Discharging	GR - Grab				
00530 Solids, total suspended	1 - Effluent Gross	0	-	-	-	Req Mon MO AVG	C - No Discharge	45.0 Wkly AVG	C - No Discharge	19 - mg/L	DL/D5 - Daily When Discharging	GR - Grab				
00610 Nitrogen, ammonia total [as N]	1 - Effluent Gross	0	-	-	-	Req Mon MO AVG	C - No Discharge	0.75 W/O AVG	C - No Discharge	19 - mg/L	DL/D5 - Daily When Discharging	GR - Grab				
50080 Chlorine, total residual	1 - Effluent Gross	0	-	-	-	Req Mon MO AVG	C - No Discharge	0.75 W/O AVG	C - No Discharge	19 - mg/L	DL/D5 - Daily When Discharging	GR - Grab				
82220 Flow, total	1 - Effluent Gross	0	-	-	-	Req Mon MO TOTAL	C - No Discharge	80 - Megalime	DL/D5 - Daily When Discharging	CN - Continuous						

Suppression Note
 If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Effl. Check Errors
 No errors.

Comments

Attachments

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(e), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NETDES.Reporting.Help.Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(i)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per collection. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit #: IL0022209
Major: No
Permitted Feature: A01 External Outfall
Report Dates & Status: From 12/01/24 to 12/31/24
Monitoring Period: From 12/01/24 to 12/31/24
Considerations for Form Completion:
BOV ID: W09603000002 NUMBER OF DAYS OF DISCHARGE:
Principal Executive Officer:
First Name: Stanley
Last Name: Bockewitz
No. Data Indicator (MODI):
Fourth MODI:
Parameter Name:
Monitoring Location:
Season #:
Param. MODI:

Code	Parameter Name	Monitoring Location	Season #	Param. MODI	Sample Permit Req. Value, MODI	Sample Permit Req. Value, MODI	Quantity or Excessing	Qualifier 1	Value 1	Qualifier 2	Value 2	Quality or Concentration	Qualifier 3	Value 3	Units	# of Ex.	Frequency of Analysis	Sample Type
00310	BOD, 5-day, 20 deg. C	1 - Effluent Gross	0	-	-	-	Req Mon MO AVG	C - No Discharge							15 - mg/L		DJDS - Daily When Discharging	GR - Grab
00650	Solids, total suspended	1 - Effluent Gross	0	-	-	-	Req Mon MO AVG	C - No Discharge							15 - mg/L		DJDS - Daily When Discharging	GR - Grab
00810	Nitrogen, ammonia total [as N]	1 - Effluent Gross	0	-	-	-	Req Mon DAILY MAX	C - No Discharge							15 - mg/L		DJDS - Daily When Discharging	GR - Grab
74025	Coliform, fecal general	1 - Effluent Gross	0	-	-	-	Req Mon DAILY MAX	C - No Discharge							400.0 DAILY MAX		DJDS - Daily When Discharging	GR - Grab
82220	Flow, total	1 - Effluent Gross	0	-	-	-	Req Mon MO TOTAL	C - No Discharge							80 - Mgal/mo		DJDS - Daily When Discharging	CN - Continuous

Submission Note
 If a parameter row does not contain any values for the Sample or Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors
 No errors.

Comments

Attachments
 No attachments.

Report Last Saved By:
 KNOXVILLE, CITY OF

User:
 Stanley Bockewitz

Name:
 stanb@bockinc.net

E-Mail:
 stanb@bockinc.net

DMR Copy of Record

Form Approved OMB No. 2040-0064 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business e-mail address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NPDES Reporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0064). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(f)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting burden for this collection of information is estimated to average 2 hours per outlet. Send comments on this Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Code	Parameter Name	Monitoring Location	Season #	Permit NODI	Quantity or Loading		Units		Qualifier		Value 1		Value 2		Value 3		Frequency of Analysis	Sample Type	
					Qualifier	Value 1	Qualifier	Value 2	Qualifier	Value 3	Qualifier	Value 1	Qualifier	Value 2	Qualifier	Value 3			Units
00300	Oxygen, dissolved [DO]	1 - Effluent Gross	1	-	Sample Permit Req. Value NODI	11.9	=	15.2	26 - lbd	11.9	<=	165.0 MO AVG	<=	330.0 DAILY MX	26 - lbd	11.9	<=	0.1	CP - Composite
00400	pH	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	7.49	=	6.0 MINIMUM	>=	7.49	<=	8.0 MAXIMUM	<=	8.0 MAXIMUM		7.58	<=	0	GR - Grab
00530	Solids, total suspended	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	11.9	=	15.2	26 - lbd	11.9	<=	165.0 MO AVG	<=	330.0 DAILY MX	26 - lbd	11.9	<=	0	CP - Composite
00610	Nitrogen, ammonia total [as N]	1 - Effluent Gross	2	-	Sample Permit Req. Value NODI	0.1	=	0.1	26 - lbd	0.1	<=	34.0 MO AVG	<=	56.0 DAILY MX	26 - lbd	0.1	<=	0	CP - Composite
00610	Nitrogen, ammonia total [as N]	8 - Other Treatment, Process Completions	2	-	Sample Permit Req. Value NODI	0.1	=	0.1	26 - lbd	0.1	<=	34.0 MO AVG	<=	56.0 DAILY MX	26 - lbd	0.1	<=	0	CP - Composite
50650	Flow, in conduit or thru treatment plant	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	0.242142	=	0.5761	MSD	0.242142	=	Reg Mon MO AVG	=	Reg Mon DAILY MX	MSD	0.242142	=	0	CP - Composite
50650	Chlorine, total residual	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	0.05	=	0.05	DAILY MX	0.05	<=	0.05	<=	0.05	DAILY MX	0.05	<=	0	GR - Grab

Permit #: IL0022209
 Major: No
 Permitted Feature: B01 Internal Outfall
 Report Dates & Status: From 12/01/24 to 12/31/24
 Monitoring Period:
 Considerations for Form Completion: No Data Indicator (NODI)
 ROW ID: W0950300002
 Principal Executive Officer: Stanley Sockowitz
 First Name: Stanley
 Last Name: Sockowitz
 Permit NODI:
 Permit Address: KNOXVILLE, CITY OF
 33 NORTH SIDE PUBLIC SQUARE
 KNOXVILLE, IL 61448
 Discharge: B01-0
 STP INTERNAL OUTFALL
 DMR Due Date: 01/25/25
 Title: Chief Operator
 Telephone: 308-552-2789
 Facility Location: KNOXVILLE STP
 507 SOUTH DIVISION STREET
 KNOXVILLE, IL 61448
 Status: NotDMR Validated

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously unfiled information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NEDES at NEDES@EPA.gov for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0084). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(i)(4)(v). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information is estimated to average 2 hours per outlet. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave, NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit #:	IL0022208	Permittee:	KNOXVILLE, CITY OF	Facility:	KNOXVILLE STP
Major:	No	Permittee Address:	33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61448	Facility Location:	507 SOUTH DIVISION STREET KNOXVILLE, IL 61448
Permitted Feature:	INF Influent Structure	Discharge:	INF-L INFLUENT MONITORING	Status:	NotDMR Validated
Report Dates & Status		DMR Due Date:	01/25/25	Telephone:	309-852-2789
Monitoring Period:	From 12/01/24 to 12/31/24	Title:	Chief Operator		
Considerations for Form Completion					
BOJ ID: W0850300002					
Principal Executive Officer					
First Name:	Stanley				
Last Name:	Bookwitz				
Fourth NODI:					
Cell:					

Code	Permit	Monitoring Location	Seasons	Permit NODI	Sample Permit Recd Value (NODI)	Quantity or Loading Qualifier 1	Value 1	Quantity or Loading Qualifier 2	Value 2	Quality or Concentration Qualifier 1	Value 3	Units	# of Ex	Frequency of Analysis	Sample Type
00310	BOD, 5-day, 20 deg. C	G - Raw Sewage Influent	0	-						170.0	Req Mon MO AVG	15 - npl	0	09/99 - See Permit	CP - Composite
00530	Solids, total suspended	G - Raw Sewage Influent	0	-						147.0	Req Mon MO AVG	15 - npl	0	09/99 - See Permit	CP - Composite
50060	Flow, in conduit or thru treatment plant	G - Raw Sewage Influent	0	-						0.6751	Req Mon DAILY MX	03 - MGD	0	09/99 - Continuous	CP - Composite

Submission Note
If a parameter row does not contain any values for the Sample or Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors

Comments

Attachments
No attachments

Report Last Saved By
KNOXVILLE, CITY OF

User: bookinc1992
Name: Stanley Bookwitz
E-Mail: stanb@bookinc.net
Date/Time: 2025-01-06 14:44 (Time Zone: -05:00)

Report Last Signed By
User: bookinc1992
Name: Stanley Bookwitz
E-Mail: stanb@bookinc.net