

RECEIVED

AUG 12 2025

CITY OF KNOXVILLE

BOCK INC.
MONTHLY REPORT FOR
July, 2025

SUBMITTED BY: _____ ***SB*** _____

July, 2025

IEPA SUMMARY

There were no communications with IEPA.

MAINTENANCE SUMMARY

BOCK Inc. changed and ordered new turnbuckles for the final clarifier and installed a new Blower in the plant.

SAFETY

Because safety is an important part of our daily practice, we have been without a loss time injury at the plant for 276 months.

OPERATIONS SUMMARY

Influent flow averaged 576,868 gallons per day.

Electricity used totaled 26,648 kilowatt hours.

Rainfall totaled 9.45 inches.




The plant had three days of overflow discharge for the month.

**Knoxville, Illinois
Wastewater Treatment Plant
Twelve Month Moving Average Report
Submitted by
Bock Inc.**

Date		Influent - Daily Average Flow (gallons per day)	Total Electrical Usage (kilowatt hours)	Total Rainfall (inches)
1	January 2025	303,742	59,904	1.12
2	February 2025	306,543	48,384	0.38
3	March 2025	684,384	40,704	4.00
4	April 2025	719,240	33,792	3.44
5	May 2025	427,658	29,952	2.97
6	June 2025	361,907	25,728	4.83
7	July 2025	576,868	26,648	9.45
8	August 2024	480,132	29,184	4.35
9	September 2024	312,203	31,104	1.46
10	October 2024	179,897	24,960	1.54
11	November 2024	300,413	46,464	3.08
12	December 2024	242,142	58,368	1.39
Total		4,895,129	455,192	38.01
Average		753,097	70,030	3.17

Plant Design Average Flow is
660,000 gallons per day

Plant Design Maximum Flow is
1,650,000 gallons per day

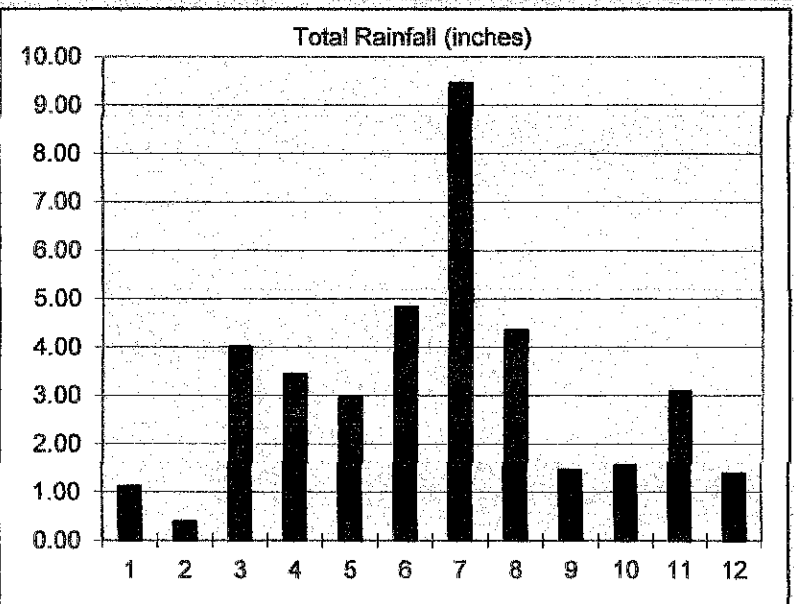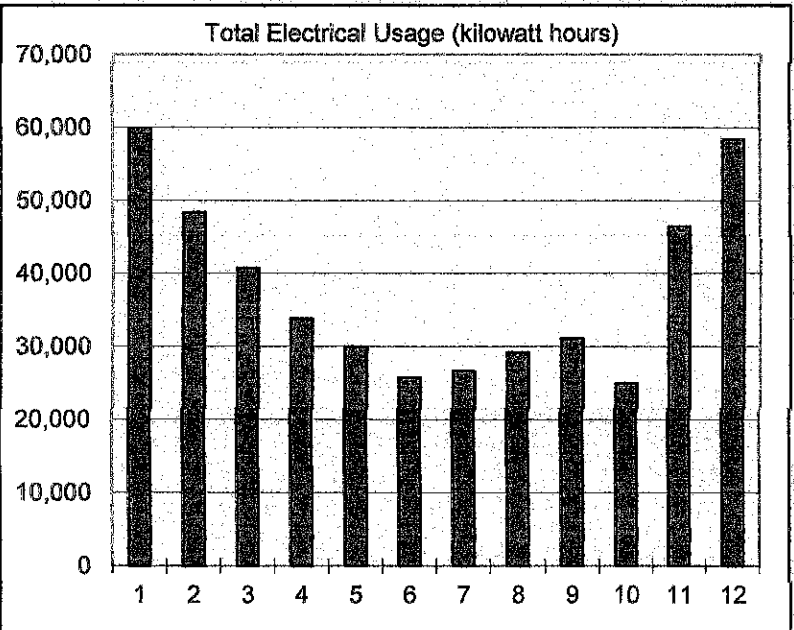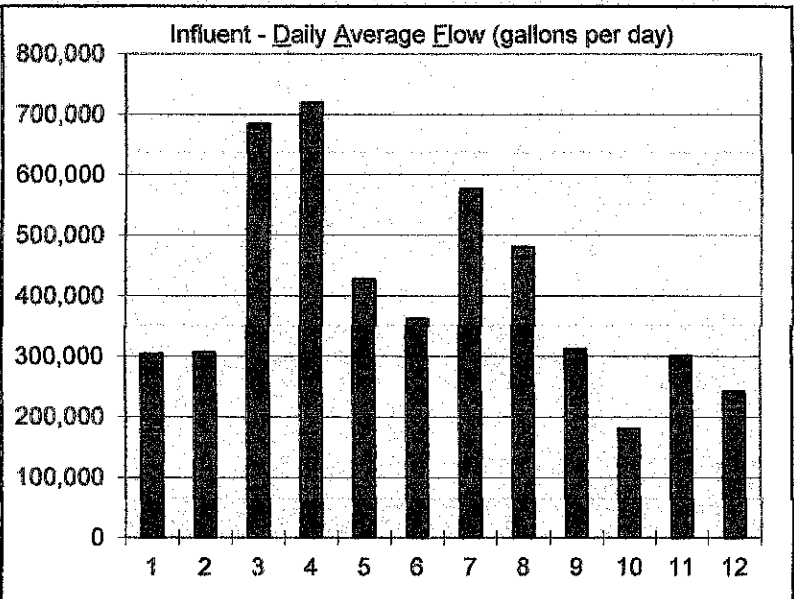

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report July, 2025

Date	Influent Flow (mgd)	RAS Flow (mgd)	WAS Flow (mgd)	Influent TSS (mg/l)	B01 TSS (mg/l)	TSS % Removal (mg/l)	Influent TSS (lbs/day)	B01 TSS (lbs/day)	TSS % Removal (lbs/day)	Outfall B01				
										pH (std. units)	D.O. (mg/l)	NH3 as (N) (mg/l)	NH3 as (N) (lbs/day)	Fecal Coliform (cfu/100)
7/1/2025	0.274700	0.082400	0.013260											
7/2/2025	0.253500	0.076100	0.000000											
7/3/2025	0.234900	0.070500	0.000000											
7/4/2025	0.239700	0.071900	0.000000											
7/5/2025	0.258400	0.077500	0.000000											
7/6/2025	0.217400	0.085200	0.000000											
7/7/2025	0.222000	0.066600	0.000000							7.32	7.20	0.100	0.2	2,420
7/8/2025	0.222200	0.066700	0.008840											
7/9/2025	0.191800	0.057500	0.000000											
7/10/2025	0.218900	0.065700	0.008840											
7/11/2025	0.694700	0.208400	0.000000	153.0	3.2	97.9	886	18.5	97.9					
7/12/2025	0.524000	0.157200	0.000000											
7/13/2025	0.385700	0.115700	0.000000											
7/14/2025	0.320700	0.096200	0.000000											
7/15/2025	0.335800	0.100700	0.008840											
7/16/2025	0.316900	0.095100	0.008840											
7/17/2025	0.263400	0.079000	0.000000							7.39	8.56	0.100	0.2	2,420
7/18/2025	0.264600	0.079400	0.008840	72	2.6	96.4	159	5.7	96.4					
7/19/2025	0.676400	0.202900	0.000000											
7/20/2025	0.605100	0.181500	0.000000											
7/21/2025	0.404000	0.121200	0.008840											
7/22/2025	0.384700	0.115400	0.000000											
7/23/2025	0.386200	0.115900	0.000000											
7/24/2025	0.434500	0.130400	0.013260											
7/25/2025	1.301700	0.390500	0.013260											
7/26/2025	1.214300	0.364300	0.000000											
7/27/2025	1.150600	0.345200	0.000000											
7/28/2025	1.537400	0.461200	0.000000											
7/29/2025	1.456100	0.436800	0.008840											
7/30/2025	1.473100	0.441900	0.008840											
7/31/2025	1.419500	0.425900	0.008840											
Minimum	0.191800	0.057500	0.000000	72.0	2.6	96.4	159	5.7	96.4	7.32	7.20	<0.100	0.2	2,420
Maximum	1.537400	0.461200	0.013260	153.0	3.2	97.9	886	18.5	97.9	7.39	8.56	<0.100	0.2	2,420
Total	17.882900	5.364900	0.119340	225	5.8	194	1,045	24.3	194	14.7	15.8	0.200	0.4	4,840
Average	0.576868	0.173061	0.003850	112.5	2.9	97.1	523	12.1	97.1	7.36	7.88	0.100	0.2	2,420

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report for July, 2025

Date	Influent BOD (mg/l)	BOD CBOD (mg/l)	BOD % Removal (mg/l)	Influent BOD (lbs/day)	BOD CBOD (lbs/day)	BOD % Removal (lbs/day)	Electrical Usage (kwh's)	High Temperature (degrees F)	Low Temperature (degrees F)	Rainfall (inches)	Snowfall (Inches)
7/1/2025							768	84.2	63.0		
7/2/2025							768	84.7	63.6		
7/3/2025							768	87.7	68.5		
7/4/2025							1,152	89.4	70.1		
7/5/2025							768	88.2	70.4	0.29	
7/6/2025							768	84.6	65.6		
7/7/2025	210	<4.00	98.1	389	7.4	98.1	768	84.2	68.0		
7/8/2025							768	81.6	65.5	0.09	
7/9/2025							152	86.7	67.2		
7/10/2025							768	87.9	71.9	0.09	
7/11/2025							1,152	88.9	66.0	1.72	
7/12/2025							768	82.0	65.8		
7/13/2025							768	78.9	65.4		
7/14/2025							768	84.3	65.4		
7/15/2025							768	87.8	72.1		
7/16/2025							1,152	85.4	70.1		
7/17/2025	72	<4.00	94.4	158	8.8	94.4	768	75.3	63.7		
7/18/2025							1,152	80.6	65.1	0.69	
7/19/2025							1,152	83.6	69.6	0.88	
7/20/2025							768	83.1	67.7		
7/21/2025							768	80.3	69.1		
7/22/2025							768	86.3	75.0		
7/23/2025							384	90.6	75.2		
7/24/2025							768	86.0	72.5	0.98	
7/25/2025							1,152	84.0	70.8	2.02	
7/26/2025							768	84.0	70.8	0.02	
7/27/2025							1,152	88.1	71.6	1.63	
7/28/2025							768	88.2	70.1	0.04	
7/29/2025							1,152	89.9	69.5	0.02	
7/30/2025							1,152	77.7	64.7	0.98	
7/31/2025							1,152	75.3	56.6		
Minimum	72.0	<4.00	94.4	158	7.4	94.4	152	75.3	56.6	0.02	
Maximum	210.0	<4.00	98.1	389	8.8	98.1	1,152	90.6	75.2	2.02	
Total	282.0	8.00	192.5	547	16.2	192.5	26,648	2,620	2,111	9.45	
Average	141.0	4.00	96.3	274	8.1	96.3	860	84.5	68.1	0.73	

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report for July, 2025
 Outfall A01
 Excess Flow Discharge

Date	BOD (mg/l)	TSS (mg/l)	NH3 (as N) (mg/l)	Fecal Coliform (cfu's/100ml)	Flow (mgd)
7/1/2025					0.000000
7/2/2025					0.000000
7/3/2025					0.000000
7/4/2025					0.000000
7/5/2025					0.000000
7/6/2025					0.000000
7/7/2025					0.000000
7/8/2025					0.000000
7/9/2025					0.000000
7/10/2025					0.000000
7/11/2025					0.000000
7/12/2025					0.000000
7/13/2025					0.000000
7/14/2025					0.000000
7/15/2025					0.000000
7/16/2025					0.000000
7/17/2025					0.000000
7/18/2025					0.000000
7/19/2025					0.000000
7/20/2025					0.000000
7/21/2025					0.000000
7/22/2025					0.000000
7/23/2025					0.000000
7/24/2025					0.000000
7/25/2025					0.000000
7/26/2025	15.0	20.0	3.40	>2,420	0.476000
7/27/2025					0.000000
7/28/2025	5.70	14.4	0.53	1,050	0.000000
7/29/2025					0.967000
7/30/2025	8.50	14.0	1.40	2.000	0.000000
7/31/2025					0.471000
Minimum	5.70	14.0	0.53	2.0	0.000000
Maximum	15.00	20.0	3.40	2,420.0	0.967000
Total	29.20	48.4	5.33	3,472.0	1.914000
Average	9.73	16.1	1.78	1,157.3	0.061742

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report for July, 2025
 Outfall 001
 Excess Flow Discharge

Date	D.O. (mg/L)	BOD (mg/L)	pH (Std.Units)	TSS (mg/L)	NH3 (as N) (mg/L)	CL2 Residual (mg/L)	Flow (mgd)
07/01/25							0.274700
07/02/25							0.253500
07/03/25							0.234900
07/04/25							0.239700
07/05/25							0.258400
07/06/25							0.217400
07/07/25							0.222000
07/08/25							0.222200
07/09/25							0.191800
07/10/25							0.218900
07/11/25							0.694700
07/12/25							0.524000
07/13/25							0.385700
07/14/25							0.320700
07/15/25							0.335800
07/16/25							0.316900
07/17/25							0.263400
07/18/25							0.264600
07/19/25							0.676400
07/20/25							0.605100
07/21/25							0.404000
07/22/25							0.384700
07/23/25							0.386200
07/24/25							0.434500
07/25/25							1.301700
07/26/25	8.30	11	7.42	19.2	2.30	0.30	1.690300
07/27/25							1.150600
07/28/25	8.71	5.4	7.60	16.0	0.40	0.30	1.537400
07/29/25							2.423100
07/30/25	8.04	7.2	7.11	10.8	0.79	0.50	1.473100
07/31/25							1.890500

Minimum	8.04	5.40	7.11	10.8	0.40	0.30	0.191800
Maximun	8.71	5.40	7.60	19.2	2.30	0.50	2.423100
Total	25.05	23.60	22.13	46.0	3.49	1.10	19.796900
Average	8.35	7.87	7.38	15.3	1.16	0.37	0.638610

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2020

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business e-mail phone number or non-business e-mail address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not impose a need for persons to assert a claim of CBI based on the type of information requested by this form, if persons wish to assert a CBI claim we direct submitters to contact the NPDES eReporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.61(b)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information is estimated to average 2 hours per report. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (8221T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit: IL0022209
Permit #: IL0022209
Major: No
Permitted Feature: 001
External Outfall
Report Dates & Status
Monitoring Period: From 07/01/25 to 07/31/25
DMR Due Date: 08/23/25
Status: Not DMR Validated
Considerations for Form Completion
ROW ID: W0690300002; NUMBER OF DAYS OF DISCHARGE
Principal Executive Officer
First Name: Stanley
Last Name: Bockwitz
Title: Chief Operator
Telephone: 309-854-3033
No Data Indicator (NODI)
Form NODI:

Code	Parameter Name	Monitoring Location	Station #	Permit NODI	Quantity or Loading	Units	Qualifier 1	Value 1	Qualifier 2	Value 2	Qualifier 3	Value 3	Units	# of Ex.	Frequency of Analysis	Sample Type
00300	Oxygen, dissolved [DO]	1 - Effluent Gross	0	—	Sample Permit Req. Value NODI	mg/L	—	8.33	Req Mon MO AV MN	—	8.04	Req Mon MN WK AV	mg/L	10	0.005 - Daily When Discharging	GR - Grab
00310	BOD, 5-day, 20 deg. C	1 - Effluent Gross	0	—	Sample Permit Req. Value NODI	mg/L	—	7.87	Req Mon MO AV	—	7.87	Req Mon MN WK AV	mg/L	10	0.005 - Daily When Discharging	GR - Grab
00400	pH	1 - Effluent Gross	0	—	Sample Permit Req. Value NODI	—	—	7.11	Req Mon MO AV	—	7.0	Req Mon MN WK AV	—	10	0.005 - Daily When Discharging	GR - Grab
00500	Solids, total suspended	1 - Effluent Gross	0	—	Sample Permit Req. Value NODI	mg/L	—	15.3	Req Mon MO AV	—	15.3	Req Mon MN WK AV	mg/L	10	0.005 - Daily When Discharging	GR - Grab
00610	Nitrogen, ammonia total [as N]	1 - Effluent Gross	0	—	Sample Permit Req. Value NODI	mg/L	—	1.10	Req Mon MO AV	—	0.3	Req Mon MN WK AV	mg/L	10	0.005 - Daily When Discharging	GR - Grab
00660	Chloride, total residual	1 - Effluent Gross	0	—	Sample Permit Req. Value NODI	mg/L	—	0.57	Req Mon MO AV	—	0.75	Req Mon MN WK AV	mg/L	10	0.005 - Daily When Discharging	GR - Grab
02220	Flow, total	1 - Effluent Gross	0	—	Sample Permit Req. Value NODI	MGD	—	13.769	Req Mon MO AV	—	13.769	Req Mon MN WK AV	MGD	10	0.005 - Daily When Discharging	CN - Continuous

Submission Note

If a parameter row does not contain any values for the Sample or Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors

No errors

Comments

Attachments

DMR Copy of Record

Form Approved OMS No. 2040-0004 expires on 07/31/2020

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.255(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable where it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct them to contact the NEDES eReporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(h)(3)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per report. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form in this address.

Permit:	IL0022209	Permittee:	KNOXVILLE, CITY OF	Facility:	KNOXVILLE STP
Major:	No	Permittee Address:	33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61448	Facility Location:	807 SOUTH DIVISION STREET KNOXVILLE, IL 61448
Permitted Feature:	A01 External Outfall	Discharge:	A01-0 EXCESS FLOW		
Report Dates & Status:					
Monitoring Period:	From 07/01/25 to 07/31/25	DMR Due Date:	08/25/25	Status:	Not DMR Validated
Considerations for Form Completion					
BOW ID: W0650300002; NUMBER OF DAYS OF DISCHARGE:					
Principal Executive Officer					
First Name:	Stanley	Title:	Chief Operator	Telephone:	309-854-3033
Last Name:	Bockowitz				
No Data Indicator (NODI)					
Form NODI:					

Code	Parameter Name	Monitoring Location	Season	Param. NODI	Qualifier	Value 1	Qualifier 2	Value 2	Units	Qualifier 1	Value 1	Qualifier 2	Value 2	Units	Ex. Ex.	Frequency of Analysis	Sample Type
00310	BOD, 5-day, 20 deg. C	1 - Effluent Gross	0	---	Sample Permit Req. Value NODI									19 - mg/L	0	DLDS - Daily When Discharging DLDS - Daily When Discharging	GR - Grab GR - Grab
00330	Solids, total suspended	1 - Effluent Gross	0	---	Sample Permit Req. Value NODI									19 - mg/L	0	DLDS - Daily When Discharging DLDS - Daily When Discharging	GR - Grab GR - Grab
00310	Nitrogen, ammonia total (as N)	1 - Effluent Gross	0	---	Sample Permit Req. Value NODI									19 - mg/L	0	DLDS - Daily When Discharging DLDS - Daily When Discharging	GR - Grab GR - Grab
X 74055	Codiform, fecal general	1 - Effluent Gross	0	---	Sample Permit Req. Value NODI									13 - #/100mL	1	DLDS - Daily When Discharging DLDS - Daily When Discharging	GR - Grab GR - Grab
82220	Flow, total	1 - Effluent Gross	0	---	Sample Permit Req. Value NODI										0	DLDS - Daily When Discharging DLDS - Daily When Discharging	CN - Continuous CN - Continuous

Submission Note

If a parameter row does not contain any values for the Sample or Effluent Tracking, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors

Code	Parameter Name	Monitoring Location	Field	Type	Description	Acknowledge
74055	Codiform, fecal general	1 - Effluent Gross	Quality or Concentration Sample Value 5	Soft	The provided sample value is outside the permit limit. Please verify that the value you have provided is correct.	Yes

Comments

Attachments

No attachments.

Report Last Saved By

KNOXVILLE, CITY OF

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2026

EPA may refuse all or the information submitted through this form if (including, but not limited to) available to the public without further notice to you. You do not use this online form to submit personal information (e.g., non-business email address, phone number, or non-business Internet address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a)(9), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to consult the NPDDES Accounting Help Desk for further guidance. Please note that EPA may contact you after you submit this record for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDDES regulations 40 CFR 122.41(h)(4)(v). An agency may not conduct or sponsor a collection of information that it does not display a currently valid OMB control number. This public review and comment period allows interested parties to comment on the Agency's need for this information, the accuracy of the provided burden, and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (20217), 1225 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in your comments. Do not send the completed form to this address.

[illegible]

DMR Copy of Record

Form Approved OMB No. 2010-0004 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitter to contact the NPDES Reporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2010-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.61(b)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per outfit. Send comments on the Agency's use of this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460, include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit #:	IL0022209	Permittee:	KNOXVILLE, CITY OF	Facility:	KNOXVILLE STP
Major:	No	Permittee Address:	33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61448	Facility Location:	507 SOUTH DIVISION STREET KNOXVILLE, IL 61448
Permitted Feature:	INF Influent Structure	Discharge:	INF-L INFLUENT MONITORING		
Report Dates & Status					
Monitoring Period:	From 07/01/25 to 07/31/25	DMR Date:	08/25/25	Status:	Not DMR Validated
Considerations for Form Completion					
CDW ID:	W0950300002				
Principal Executive Officer					
First Name:	Stanley	Title:	Chief Operator	Telephone:	306-854-9033
Last Name:	Bockwitz				
No Data Indicator (NODI)					
Form NODI:	--				

Code	Parameter Name	Monitoring Location	Season #	Param. NODI	Qualifier 1	Value 1	Qualifier 2	Value 2	Units	Qualifier 1	Value 1	Qualifier 2	Value 2	Units	# of Ex.	Frequency of Analysis	Sample Type
00310	BOD ₅ , 5-day, 20 deg. C	G - Raw Sewage Influent	0	--	Sample Permit Req. Value NODI						111.0	Req Mon MO AVG		10 - mg/L	0	09/09 - See Permit	GP - Composite
00530	Solids, total suspended	G - Raw Sewage Influent	0	--	Sample Permit Req. Value NODI						112.5	Req Mon MO AVG		10 - mg/L	0	09/09 - See Permit	GP - Composite
00000	Flow, in conduit or thru treatment plant	G - Raw Sewage Influent	0	--	Sample Permit Req. Value NODI	0.0000		1.5974	MG - MG/D					MG - MG/D	0	09/09 - Continuous	

Submission Note

If a parameter row does not contain any values for the Sample or Effluent Tracking, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors

No errors.

Comments

Attachments

No attachments.

Report Last Saved By

KNOXVILLE, CITY OF

User:

bockinc1992

Name:

Stanley Bockwitz

E-Mail:

stanb@bockinc.net

Date/Time:

2025-08-06 15:09 (Time Zone: -05:00)

Report Last Signed By

User:

bockinc1992

Name:

Stanley Bockwitz

E-Mail:

stanb@bockinc.net