

RECEIVED

SEP - 9 2025

CITY OF KNOXVILLE

***BOCK INC.***  
***MONTHLY REPORT FOR***  
***AUGUST, 2025***

***SUBMITTED BY:*** \_\_\_\_\_ ***SB*** \_\_\_\_\_

**August, 2025**

**IEPA SUMMARY**

There were no communications with IEPA.

**MAINTENANCE SUMMARY**

BOCK Inc. performed all preventive maintenance for the plant.  
New blower was installed and started up.

**SAFETY**

Because safety is an important part of our daily practice, we  
have been without a loss time injury at the plant for 277 months.

**OPERATIONS SUMMARY**

Influent flow averaged 340,329 gallons per day.

Electricity used totaled 28,416 kilowatt hours.




Rainfall totaled 1.8 inches.

**Knoxville, Illinois  
Wastewater Treatment Plant  
Twelve Month Moving Average Report  
Submitted by  
Bock Inc.**

|         | Date           | Influent - Daily Average Flow (gallons per day) | Total Electrical Usage (kilowatt hours) | Total Rainfall (inches) |
|---------|----------------|-------------------------------------------------|-----------------------------------------|-------------------------|
| 1       | January 2025   | 303,742                                         | 59,904                                  | 1.12                    |
| 2       | February 2025  | 306,543                                         | 48,384                                  | 0.38                    |
| 3       | March 2025     | 684,384                                         | 40,704                                  | 4.00                    |
| 4       | April 2025     | 719,240                                         | 33,792                                  | 3.44                    |
| 5       | May 2025       | 427,658                                         | 29,952                                  | 2.97                    |
| 6       | June 2025      | 361,907                                         | 25,728                                  | 4.83                    |
| 7       | July 2025      | 576,868                                         | 26,648                                  | 9.45                    |
| 8       | August 2025    | 340,329                                         | 28,416                                  | 1.83                    |
| 9       | September 2024 | 312,203                                         | 31,104                                  | 1.46                    |
| 10      | October 2024   | 179,897                                         | 24,960                                  | 1.54                    |
| 11      | November 2024  | 300,413                                         | 46,464                                  | 3.08                    |
| 12      | December 2024  | 242,142                                         | 58,368                                  | 1.39                    |
| Total   |                | 4,755,326                                       | 454,424                                 | 35.49                   |
| Average |                | 731,589                                         | 69,911                                  | 2.96                    |

Plant Design Average Flow is  
660,000 gallons per day

Plant Design Maximum Flow is  
1,650,000 gallons per day

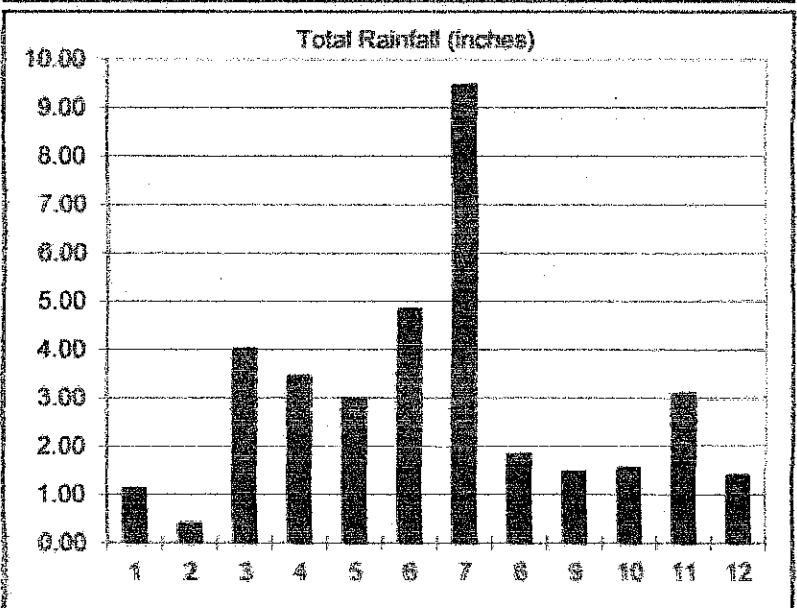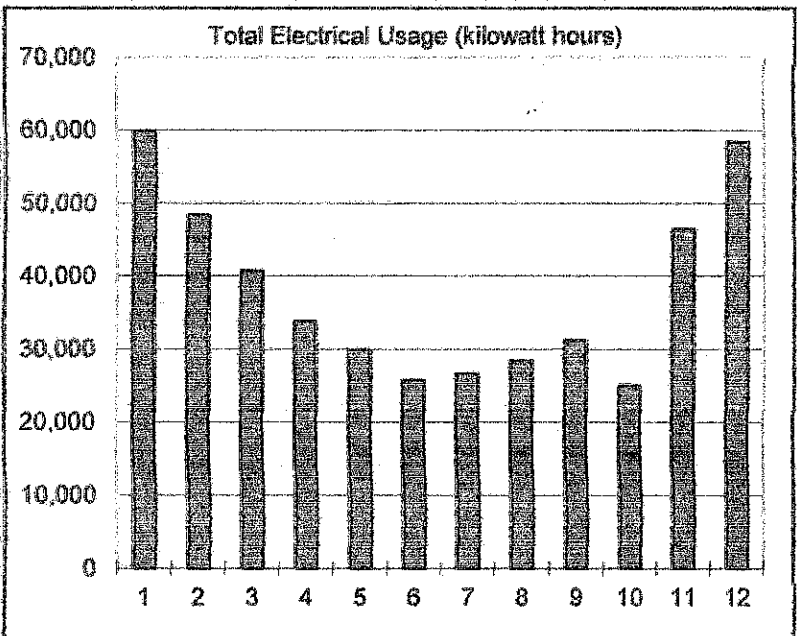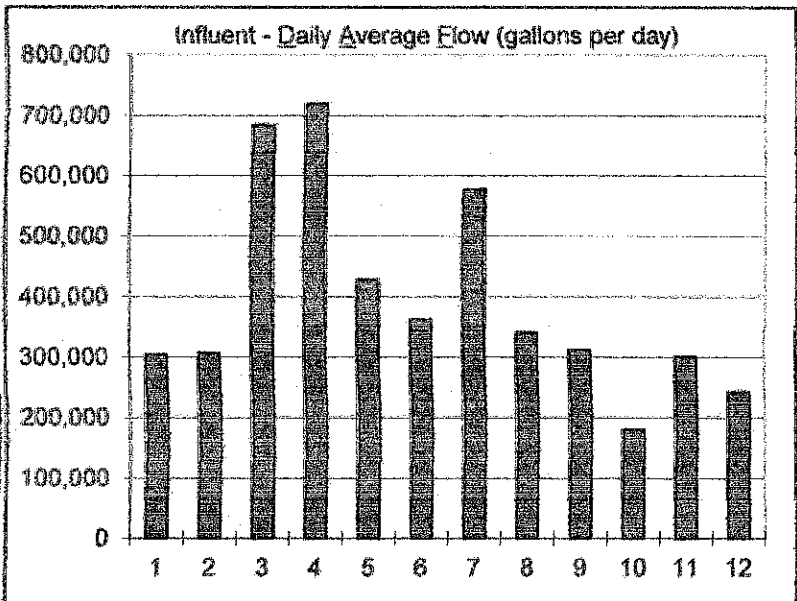

Knoxville, Illinois Wastewater Treatment Plant  
 Operated by Bock Inc.  
 Monthly Report August, 2025

| Date      | Influent Flow<br>(mgd) | RAS Flow<br>(mgd) | WAS Flow<br>(mgd) | Influent TSS<br>(mg/l) | B01 TSS<br>(mg/l) | TSS % Removal<br>(mg/l) | Influent TSS<br>(lbs/day) | B01 TSS<br>(lbs/day) | TSS % Removal<br>(lbs/day) | Outfall B01        |                |                      |                         |                             |       |       |
|-----------|------------------------|-------------------|-------------------|------------------------|-------------------|-------------------------|---------------------------|----------------------|----------------------------|--------------------|----------------|----------------------|-------------------------|-----------------------------|-------|-------|
|           |                        |                   |                   |                        |                   |                         |                           |                      |                            | pH<br>(std. units) | D.O.<br>(mg/l) | NH3 as (N)<br>(mg/l) | NH3 as (N)<br>(lbs/day) | Fecal Coliform<br>(cfu/100) |       |       |
| 8/1/2025  | 1.082300               | 0.324700          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/2/2025  | 0.729300               | 0.218800          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/3/2025  | 0.609900               | 0.182700          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/4/2025  | 0.583100               | 0.174900          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/5/2025  | 0.481000               | 0.144300          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/6/2025  | 0.438700               | 0.131600          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/7/2025  | 0.421300               | 0.126400          | 0.000000          |                        |                   |                         |                           |                      |                            | 7.72               | 9.11           | 0.100                | 0.4                     | 2.420                       |       |       |
| 8/8/2025  | 0.402700               | 0.120800          | 0.013260          | 72                     | 2.0               | 97.2                    | 242                       | 6.7                  | 97.2                       |                    |                |                      |                         |                             |       |       |
| 8/9/2025  | 0.379500               | 0.113900          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/10/2025 | 0.391800               | 0.117500          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/11/2025 | 0.323900               | 0.097200          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/12/2025 | 0.334000               | 0.100200          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/13/2025 | 0.279300               | 0.083800          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/14/2025 | 0.274500               | 0.082400          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/15/2025 | 0.384400               | 0.115300          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/16/2025 | 0.265900               | 0.079800          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/17/2025 | 0.253600               | 0.076100          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/18/2025 | 0.380900               | 0.114300          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/19/2025 | 0.297600               | 0.089300          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/20/2025 | 0.244100               | 0.073200          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/21/2025 | 0.211500               | 0.063500          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/22/2025 | 0.256100               | 0.076500          | 0.000000          | 75.0                   | 2.2               | 97.1                    | 160                       | 4.7                  | 97.1                       |                    |                | 7.58                 | 8.38                    | 0.100                       | 0.2   | 2.420 |
| 8/23/2025 | 0.170900               | 0.051300          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/24/2025 | 0.169800               | 0.050900          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/25/2025 | 0.166300               | 0.049900          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/26/2025 | 0.169900               | 0.050700          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/27/2025 | 0.160400               | 0.048100          | 0.008840          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/28/2025 | 0.160500               | 0.048200          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/29/2025 | 0.226000               | 0.067800          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/30/2025 | 0.157200               | 0.047200          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| 8/31/2025 | 0.146700               | 0.044000          | 0.000000          |                        |                   |                         |                           |                      |                            |                    |                |                      |                         |                             |       |       |
| Minimum   | 0.146700               | 0.044000          | 0.000000          | 72.0                   | 2.0               | 97.1                    | 160                       | 4.7                  | 97.1                       | 7.58               | 8.38           | <0.100               | 0.2                     |                             | 2.420 |       |
| Maximum   | 1.082300               | 0.324700          | 0.013260          | 75.0                   | 2.2               | 97.2                    | 242                       | 6.7                  | 97.2                       | 7.72               | 9.11           | <0.100               | 0.4                     |                             | 2.420 |       |
| Total     | 10.550200              | 3.165300          | 0.110500          | 147                    | 4.2               | 194                     | 401                       | 11.4                 | 194                        | 15.3               | 17.5           | 0.200                | 0.5                     |                             | 4.840 |       |
| Average   | 0.340329               | 0.102106          | 0.003565          | 73.5                   | 2.1               | 97.1                    | 201                       | 5.7                  | 97.1                       | 7.65               | 8.75           | 0.100                | 0.3                     |                             | 2.420 |       |

# Knoxville, Illinois Wastewater Treatment Plant

Operated by Bock Inc.

Monthly Report for August, 2025

| Date      | Influent BOD (mg/l) | BOD CBOD (mg/l) | BOD % Removal (mg/l) | Influent BOD (lbs/day) | BOD CBOD (lbs/day) | BOD % Removal (lbs/day) | Electrical Usage (kwh's) | High Temperature (degrees F) | Low Temperature (degrees F) | Rainfall (inches) | Snowfall (inches) |
|-----------|---------------------|-----------------|----------------------|------------------------|--------------------|-------------------------|--------------------------|------------------------------|-----------------------------|-------------------|-------------------|
| 8/1/2025  |                     |                 |                      |                        |                    |                         | 768                      | 77.5                         | 57.0                        |                   |                   |
| 8/2/2025  |                     |                 |                      |                        |                    |                         | 1,152                    | 77.1                         | 57.3                        |                   |                   |
| 8/3/2025  |                     |                 |                      |                        |                    |                         | 1,152                    | 77.7                         | 59.1                        |                   |                   |
| 8/4/2025  |                     |                 |                      |                        |                    |                         | 768                      | 80.7                         | 62.5                        |                   |                   |
| 8/5/2025  |                     |                 |                      |                        |                    |                         | 768                      | 82.2                         | 62.9                        |                   |                   |
| 8/6/2025  |                     |                 |                      |                        |                    |                         | 1,152                    | 84.0                         | 69.1                        | 0.04              |                   |
| 8/7/2025  | 88                  | <4.00           | 95.5                 | 309                    | 14.1               | 95.5                    | 768                      | 82.5                         | 70.1                        |                   |                   |
| 8/8/2025  |                     |                 |                      |                        |                    |                         | 768                      | 86.3                         | 73.5                        |                   |                   |
| 8/9/2025  |                     |                 |                      |                        |                    |                         | 1,152                    | 86.0                         | 74.3                        | 0.10              |                   |
| 8/10/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 79.7                         | 68.3                        |                   |                   |
| 8/11/2025 |                     |                 |                      |                        |                    |                         | 768                      | 83.5                         | 68.3                        | 0.14              |                   |
| 8/12/2025 |                     |                 |                      |                        |                    |                         | 768                      | 83.4                         | 66.5                        |                   |                   |
| 8/13/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 83.7                         | 60.0                        |                   |                   |
| 8/14/2025 |                     |                 |                      |                        |                    |                         | 384                      | 83.7                         | 65.2                        |                   |                   |
| 8/15/2025 |                     |                 |                      |                        |                    |                         | 384                      | 90.8                         | 69.8                        | 0.46              |                   |
| 8/16/2025 |                     |                 |                      |                        |                    |                         | 768                      | 91.5                         | 74.3                        |                   |                   |
| 8/17/2025 |                     |                 |                      |                        |                    |                         | 768                      | 89.2                         | 72.4                        |                   |                   |
| 8/18/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 91.5                         | 71.6                        | 0.67              |                   |
| 8/19/2025 |                     |                 |                      |                        |                    |                         | 768                      | 84.1                         | 65.7                        |                   |                   |
| 8/20/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 82.1                         | 60.6                        |                   |                   |
| 8/21/2025 | 97.0                | <4.00           | 95.9                 | 171                    | 7.1                | 95.9                    | 768                      | 79.2                         | 61.3                        |                   |                   |
| 8/22/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 80.0                         | 64.3                        |                   |                   |
| 8/23/2025 |                     |                 |                      |                        |                    |                         | 768                      | 80.3                         | 54.7                        |                   |                   |
| 8/24/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 72.9                         | 49.6                        |                   |                   |
| 8/25/2025 |                     |                 |                      |                        |                    |                         | 768                      | 71.2                         | 47.0                        |                   |                   |
| 8/26/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 73.2                         | 49.0                        |                   |                   |
| 8/27/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 73.5                         | 57.4                        |                   |                   |
| 8/28/2025 |                     |                 |                      |                        |                    |                         | 768                      | 81.0                         | 59.5                        |                   |                   |
| 8/29/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 78.8                         | 59.6                        | 0.42              |                   |
| 8/30/2025 |                     |                 |                      |                        |                    |                         | 768                      | 78.1                         | 58.0                        |                   |                   |
| 8/31/2025 |                     |                 |                      |                        |                    |                         | 1,152                    | 75.9                         | 55.2                        |                   |                   |
| Minimum   | 88.0                | <4.00           | 95.5                 | 171                    | 7.1                | 95.5                    | 384                      | 71.2                         | 47.0                        | 0.04              | 0.0               |
| Maximum   | 97.0                | <4.00           | 95.9                 | 309                    | 14.1               | 95.9                    | 1,152                    | 91.5                         | 74.3                        | 0.67              | 0.0               |
| Total     | 185.0               | 8.00            | 191.3                | 480                    | 21.1               | 191.3                   | 28,416                   | 2,525                        | 1,944                       | 1.83              | 0.0               |
| Average   | 92.5                | 4.00            | 95.7                 | 240                    | 10.6               | 95.7                    | 917                      | 81.5                         | 62.7                        | 0.31              |                   |

Knoxville, Illinois Wastewater Treatment Plant  
 Operated by Bock Inc.  
 Monthly Report for August, 2025  
 Outfall A01  
 Excess Flow Discharge

| Date      | BOD<br>(mg/l) | TSS<br>(mg/l) | NH3 (as N)<br>(mg/l) | Fecal<br>Coliform<br>(cfu's/100ml) | Flow<br>(mgd) |
|-----------|---------------|---------------|----------------------|------------------------------------|---------------|
| 8/1/2025  |               |               |                      |                                    | 0.000000      |
| 8/2/2025  |               |               |                      |                                    | 0.000000      |
| 8/3/2025  |               |               |                      |                                    | 0.000000      |
| 8/4/2025  |               |               |                      |                                    | 0.000000      |
| 8/5/2025  |               |               |                      |                                    | 0.000000      |
| 8/6/2025  |               |               |                      |                                    | 0.000000      |
| 8/7/2025  |               |               |                      |                                    | 0.000000      |
| 8/8/2025  |               |               |                      |                                    | 0.000000      |
| 8/9/2025  |               |               |                      |                                    | 0.000000      |
| 8/10/2025 |               |               |                      |                                    | 0.000000      |
| 8/11/2025 |               |               |                      |                                    | 0.000000      |
| 8/12/2025 |               |               |                      |                                    | 0.000000      |
| 8/13/2025 |               |               |                      |                                    | 0.000000      |
| 8/14/2025 |               |               |                      |                                    | 0.000000      |
| 8/15/2025 |               |               |                      |                                    | 0.000000      |
| 8/16/2025 |               |               |                      |                                    | 0.000000      |
| 8/17/2025 |               |               |                      |                                    | 0.000000      |
| 8/18/2025 |               |               |                      |                                    | 0.000000      |
| 8/19/2025 |               |               |                      |                                    | 0.000000      |
| 8/20/2025 |               |               |                      |                                    | 0.000000      |
| 8/21/2025 |               |               |                      |                                    | 0.000000      |
| 8/22/2025 |               |               |                      |                                    | 0.000000      |
| 8/23/2025 |               |               |                      |                                    | 0.000000      |
| 8/24/2025 |               |               |                      |                                    | 0.000000      |
| 8/25/2025 |               |               |                      |                                    | 0.000000      |
| 8/26/2025 |               |               |                      |                                    | 0.000000      |
| 8/27/2025 |               |               |                      |                                    | 0.000000      |
| 8/28/2025 |               |               |                      |                                    | 0.000000      |
| 8/29/2025 |               |               |                      |                                    | 0.000000      |
| 8/30/2025 |               |               |                      |                                    | 0.000000      |
| 8/31/2025 |               |               |                      |                                    | 0.000000      |
| Minimum   |               |               |                      |                                    | 0.000000      |
| Maximum   |               |               |                      |                                    | 0.000000      |
| Total     |               |               |                      |                                    | 0.000000      |
| Average   |               |               |                      |                                    | 0.000000      |

Knoxville, Illinois Wastewater Treatment Plant  
 Operated by Bock Inc.  
 Monthly Report for August, 2025  
 Outfall 001  
 Excess Flow Discharge

| Date     | D.O.<br>(mg/L) | BOD<br>(mg/L) | pH<br>(Std.Units) | TSS<br>(mg/L) | NH3 (as N)<br>(mg/L) | CL2 Residual<br>(mg/L) | Flow<br>(mgd) |
|----------|----------------|---------------|-------------------|---------------|----------------------|------------------------|---------------|
| 08/01/25 |                |               |                   |               |                      |                        | 1.082300      |
| 08/02/25 |                |               |                   |               |                      |                        | 0.729300      |
| 08/03/25 |                |               |                   |               |                      |                        | 0.608900      |
| 08/04/25 |                |               |                   |               |                      |                        | 0.583100      |
| 08/05/25 |                |               |                   |               |                      |                        | 0.481000      |
| 08/06/25 |                |               |                   |               |                      |                        | 0.438700      |
| 08/07/25 |                |               |                   |               |                      |                        | 0.421300      |
| 08/08/25 |                |               |                   |               |                      |                        | 0.402700      |
| 08/09/25 |                |               |                   |               |                      |                        | 0.379500      |
| 08/10/25 |                |               |                   |               |                      |                        | 0.391800      |
| 08/11/25 |                |               |                   |               |                      |                        | 0.323900      |
| 08/12/25 |                |               |                   |               |                      |                        | 0.334000      |
| 08/13/25 |                |               |                   |               |                      |                        | 0.279300      |
| 08/14/25 |                |               |                   |               |                      |                        | 0.274500      |
| 08/15/25 |                |               |                   |               |                      |                        | 0.384400      |
| 08/16/25 |                |               |                   |               |                      |                        | 0.265900      |
| 08/17/25 |                |               |                   |               |                      |                        | 0.253600      |
| 08/18/25 |                |               |                   |               |                      |                        | 0.380900      |
| 08/19/25 |                |               |                   |               |                      |                        | 0.297600      |
| 08/20/25 |                |               |                   |               |                      |                        | 0.244100      |
| 08/21/25 |                |               |                   |               |                      |                        | 0.211500      |
| 08/22/25 |                |               |                   |               |                      |                        | 0.255100      |
| 08/23/25 |                |               |                   |               |                      |                        | 0.170900      |
| 08/24/25 |                |               |                   |               |                      |                        | 0.169800      |
| 08/25/25 |                |               |                   |               |                      |                        | 0.166300      |
| 08/26/25 |                |               |                   |               |                      |                        | 0.168900      |
| 08/27/25 |                |               |                   |               |                      |                        | 0.160400      |
| 08/28/25 |                |               |                   |               |                      |                        | 0.160600      |
| 08/29/25 |                |               |                   |               |                      |                        | 0.226000      |
| 08/30/25 |                |               |                   |               |                      |                        | 0.157200      |
| 08/31/25 |                |               |                   |               |                      |                        | 0.146700      |

|         |  |  |  |  |  |  |           |
|---------|--|--|--|--|--|--|-----------|
| Minimum |  |  |  |  |  |  | 0.146700  |
| Maximum |  |  |  |  |  |  | 1.082300  |
| Total   |  |  |  |  |  |  | 10.550200 |
| Average |  |  |  |  |  |  | 0.340329  |

# Water Copy of Record

Form Approved OMB No. 2040-0074 expires on 07/31/2028

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information. Therefore, to protect the information, we are administratively practicable since it may, at any time, be disclosed to the public. Although we do not have a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim, we direct them to contact the [US-EPA-OMB-INFO@epa.gov](mailto:US-EPA-OMB-INFO@epa.gov) for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0074). Responses to this collection of information are mandatory in accordance with the permit and EPA NPDES regulations 40 CFR 122.41(f)(4). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting burden for this collection of information is estimated to average 2 hours per annual record, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and reviewing and revising the information. Send comments on this Agency's burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden, to Washington, D.C. 20543, Office of Management and Budget, Paperwork Project (0704-0188). Do not send this collection of information to the address.

Facility: **KNOXVILLE CITY OF**  
 23 NORTH SIDE PUBLIC SQUARE  
 KNOXVILLE, TN 37942  
 Facility Location: **KNOXVILLE STP**  
 507 SOUTH DIVISION STREET  
 KNOXVILLE, TN 37946

Facility Name: **External Outfall**  
 Discharge: **004.0**  
 Combined Discharge from All AWP SPS  
 Status: **Not Data Validated**

Reporting Period: **From 08/01/25 to 08/31/25**  
 Reporting Period: **08/25/25**  
 Status: **Not Data Validated**

Principal Executive Officer: **Stanley**  
 First Name: **Stanley**  
 Last Name: **Stanley**  
 Title: **Chief Operator**  
 Telephone: **306-644-3033**

Facility Name: **External Outfall**  
 Discharge: **004.0**  
 Combined Discharge from All AWP SPS  
 Status: **Not Data Validated**

Reporting Period: **From 08/01/25 to 08/31/25**  
 Reporting Period: **08/25/25**  
 Status: **Not Data Validated**

Principal Executive Officer: **Stanley**  
 First Name: **Stanley**  
 Last Name: **Stanley**  
 Title: **Chief Operator**  
 Telephone: **306-644-3033**

Facility Name: **External Outfall**  
 Discharge: **004.0**  
 Combined Discharge from All AWP SPS  
 Status: **Not Data Validated**

Reporting Period: **From 08/01/25 to 08/31/25**  
 Reporting Period: **08/25/25**  
 Status: **Not Data Validated**

Principal Executive Officer: **Stanley**  
 First Name: **Stanley**  
 Last Name: **Stanley**  
 Title: **Chief Operator**  
 Telephone: **306-644-3033**

Facility Name: **External Outfall**  
 Discharge: **004.0**  
 Combined Discharge from All AWP SPS  
 Status: **Not Data Validated**

Reporting Period: **From 08/01/25 to 08/31/25**  
 Reporting Period: **08/25/25**  
 Status: **Not Data Validated**

Principal Executive Officer: **Stanley**  
 First Name: **Stanley**  
 Last Name: **Stanley**  
 Title: **Chief Operator**  
 Telephone: **306-644-3033**

Facility Name: **External Outfall**  
 Discharge: **004.0**  
 Combined Discharge from All AWP SPS  
 Status: **Not Data Validated**

Reporting Period: **From 08/01/25 to 08/31/25**  
 Reporting Period: **08/25/25**  
 Status: **Not Data Validated**

Principal Executive Officer: **Stanley**  
 First Name: **Stanley**  
 Last Name: **Stanley**  
 Title: **Chief Operator**  
 Telephone: **306-644-3033**

Facility Name: **External Outfall**  
 Discharge: **004.0**  
 Combined Discharge from All AWP SPS  
 Status: **Not Data Validated**



Form Approved OMB No. 2040-0004 expires on 07/31/2026

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501, of the (KAM) Control No. 2004-2004. Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(f)(6). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. This public reporting burden for this collection of information was estimated to average 2 hours per outlet. Send comments on this information, the accuracy of the provided estimates, and any suggested methods for reducing this burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (20517), 1305 Pennsylvania Ave., NW, Washington, D.C. 20560. Include the OMB control number in any correspondence. Do not send the identified form to this address.

Printed on: 11/06/2022 09:40:22

| Major | NO  |
|-------|-----|
| 1     | 1   |
| 2     | 2   |
| 3     | 3   |
| 4     | 4   |
| 5     | 5   |
| 6     | 6   |
| 7     | 7   |
| 8     | 8   |
| 9     | 9   |
| 10    | 10  |
| 11    | 11  |
| 12    | 12  |
| 13    | 13  |
| 14    | 14  |
| 15    | 15  |
| 16    | 16  |
| 17    | 17  |
| 18    | 18  |
| 19    | 19  |
| 20    | 20  |
| 21    | 21  |
| 22    | 22  |
| 23    | 23  |
| 24    | 24  |
| 25    | 25  |
| 26    | 26  |
| 27    | 27  |
| 28    | 28  |
| 29    | 29  |
| 30    | 30  |
| 31    | 31  |
| 32    | 32  |
| 33    | 33  |
| 34    | 34  |
| 35    | 35  |
| 36    | 36  |
| 37    | 37  |
| 38    | 38  |
| 39    | 39  |
| 40    | 40  |
| 41    | 41  |
| 42    | 42  |
| 43    | 43  |
| 44    | 44  |
| 45    | 45  |
| 46    | 46  |
| 47    | 47  |
| 48    | 48  |
| 49    | 49  |
| 50    | 50  |
| 51    | 51  |
| 52    | 52  |
| 53    | 53  |
| 54    | 54  |
| 55    | 55  |
| 56    | 56  |
| 57    | 57  |
| 58    | 58  |
| 59    | 59  |
| 60    | 60  |
| 61    | 61  |
| 62    | 62  |
| 63    | 63  |
| 64    | 64  |
| 65    | 65  |
| 66    | 66  |
| 67    | 67  |
| 68    | 68  |
| 69    | 69  |
| 70    | 70  |
| 71    | 71  |
| 72    | 72  |
| 73    | 73  |
| 74    | 74  |
| 75    | 75  |
| 76    | 76  |
| 77    | 77  |
| 78    | 78  |
| 79    | 79  |
| 80    | 80  |
| 81    | 81  |
| 82    | 82  |
| 83    | 83  |
| 84    | 84  |
| 85    | 85  |
| 86    | 86  |
| 87    | 87  |
| 88    | 88  |
| 89    | 89  |
| 90    | 90  |
| 91    | 91  |
| 92    | 92  |
| 93    | 93  |
| 94    | 94  |
| 95    | 95  |
| 96    | 96  |
| 97    | 97  |
| 98    | 98  |
| 99    | 99  |
| 100   | 100 |

**internal Outlets**

From 08/01/25 to 08/31/25

ENTRY ID: W0950302602

**Administrative Executive Officer**

**Lost Page:**

### **Step 3: Find the Indicator (IND)**

FURNI, NODI

Q. 10.  $\frac{1}{2}$  of a number is 10. What is the number?

١٠٠

1000

THE CHAIRMAN

---

1982 1983

100

6622

1945 2153

100

•

**Abstract**

1  
4  
1  
1  
1  
2  
2  
2

1000

2000

1662

**Abstract**

50087 341

Form Approved OMB No. 2040-0060; expires on 07/31/2026

[illegible][illegible][illegible]

سید محمد رفیع

1891-92-93.

57664

5546

Richard A. Harkness, Jr.,

PROVINCIAL CITY OF

5

**Abstract**

卷之六

**Figure 1**

Pharmaceutical Division

1

## Reference

**E-Mail:** . . . . .

City of Knoxville  
Cemetery Report  
for August 2025

|   |                             |             |
|---|-----------------------------|-------------|
| 3 | grave openings              | \$ 1,600.00 |
| 2 | weekend/late grave openings | \$ 1,000.00 |
| 7 | sale of spaces              | \$ 4,200.00 |

|       |             |
|-------|-------------|
| TOTAL | \$ 6,800.00 |
|-------|-------------|

DEPOSITS

|                                                          |             |
|----------------------------------------------------------|-------------|
| Cemetery Current Checking (all grave openings and sales) | \$ 6,800.00 |
|----------------------------------------------------------|-------------|

|       |             |
|-------|-------------|
| TOTAL | \$ 6,800.00 |
|-------|-------------|

Contacts for Cemetery for August 2025

|   |                                     |
|---|-------------------------------------|
| 5 | phone                               |
|   | walk-ins                            |
|   | email                               |
|   | mail                                |
| 2 | follow-up calls or actions to above |
| 7 | TOTAL CONTACTS                      |