

RECEIVED

OCT 14 2025

CITY OF KNOXVILLE

BOCK INC.
MONTHLY REPORT FOR
SEPTEMBER, 2025

SUBMITTED BY: _____ ***SB*** _____

September, 2025

IEPA SUMMARY

There were no communications with IEPA.

MAINTENANCE SUMMARY

BOCK Inc. performed winter prep oil changes and installed and leveled blower 2. The step screen was also oiled and cleaned out.

SAFETY

Because safety is an important part of our daily practice, we have been without a loss time injury at the plant for 278 months.

OPERATIONS SUMMARY

Influent flow averaged 125,427 gallons per day.

Electricity used totaled 28,800 kilowatt hours.

Rainfall totaled 0.48 inches.




Dewatered sludge disposed of to the Knox County landfill totaled 0 tons.

Knoxville, Illinois
Wastewater Treatment Plant
Twelve Month Moving Average Report
Submitted by
Bock Inc.

Date		Influent - <u>Daily Average Flow</u> (gallons per day)	Total Electrical Usage (kilowatt hours)	Total Rainfall (inches)
1	January 2025	303,742	59,904	1.12
2	February 2025	306,543	48,384	0.38
3	March 2025	684,384	40,704	4.00
4	April 2025	719,240	33,792	3.44
5	May 2025	427,658	29,952	2.97
6	June 2025	361,907	25,728	4.83
7	July 2025	576,868	26,648	9.45
8	August 2025	340,329	28,416	1.83
9	September 2025	125,427	28,800	0.48
10	October 2024	179,897	24,960	1.54
11	November 2024	300,413	46,464	3.08
12	December 2024	242,142	58,368	1.39
Total		4,568,550	452,120	34.51
Average		702,854	69,557	2.88

Plant Design Average Flow is
660,000 gallons per day

Plant Design Maximum Flow is
1,650,000 gallons per day

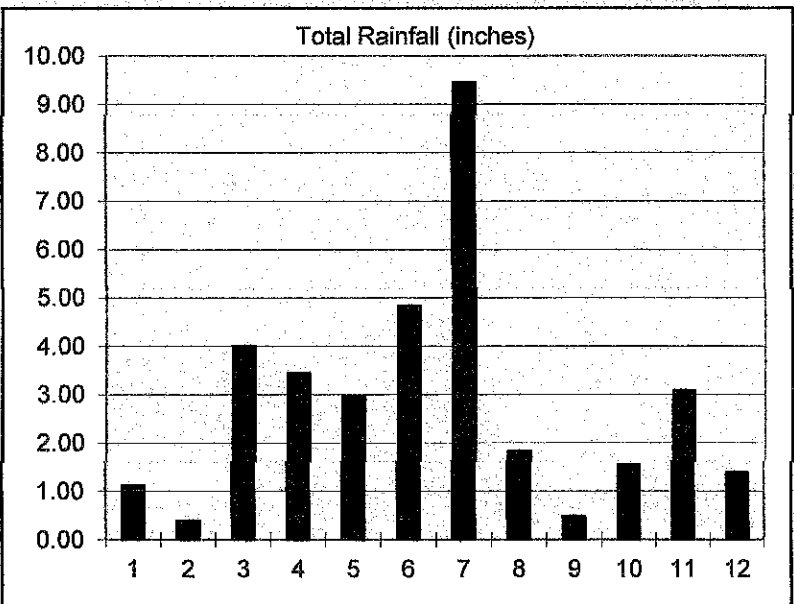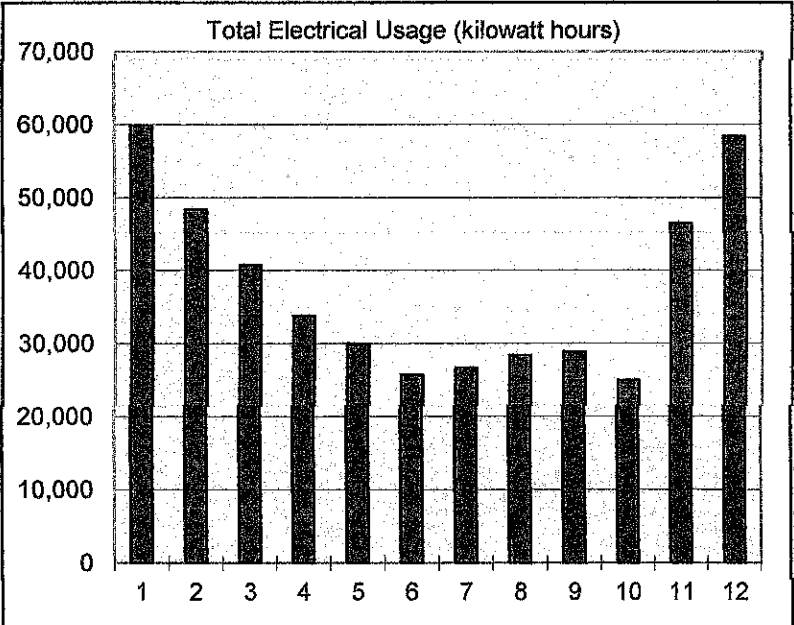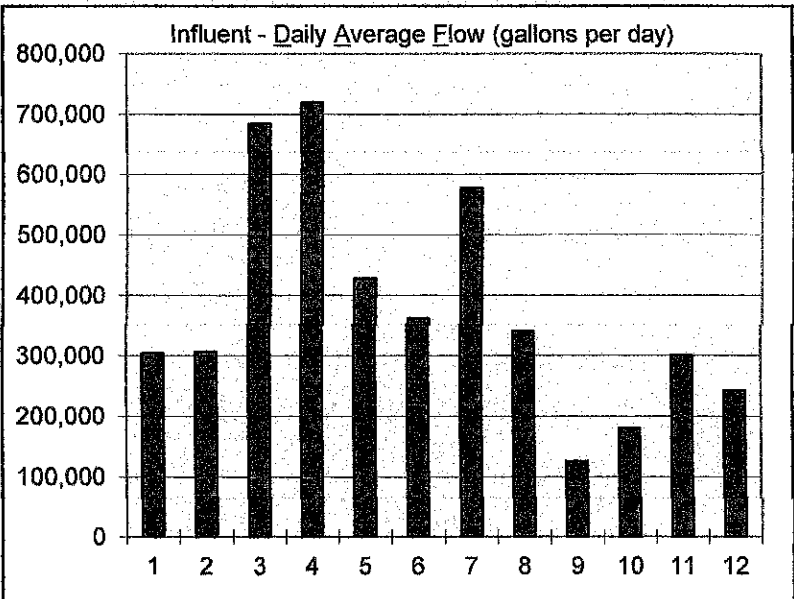

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report September, 2025

Date	Influent Flow (mgd)	RAS Flow (mgd)	WAS Flow (mgd)	Influent TSS (mg/l)	B01 TSS (mg/l)	TSS % Removal (mg/l)	Influent TSS (lbs/day)	B01 TSS (lbs/day)	TSS % Removal (lbs/day)	Outfall B01				
										pH (std. units)	D.O. (mg/l)	NH3 as (N) (mg/l)	NH3 as (N) (lbs/day)	Fecal Coliform (cfu/100)
9/1/2025	0.158400	0.047500	0.000000											
9/2/2025	0.139400	0.041800	0.000000											
9/3/2025	0.141700	0.042500	0.000000											
9/4/2025	0.128000	0.038400	0.000000	336.0	15.8	95.3	359	16.9	95.3	7.47	8.68	0.100	0.1	2,420
9/5/2025	0.135100	0.040500	0.000000											
9/6/2025	0.116000	0.034800	0.000000											
9/7/2025	0.121700	0.036500	0.000000											
9/8/2025	0.125000	0.037500	0.000000											
9/9/2025	0.115100	0.034500	0.000000											
9/10/2025	0.120100	0.036000	0.008840											
9/11/2025	0.125900	0.037800	0.000000							7.17	9.05	0.100	0.1	2,420
9/12/2025	0.136100	0.040800	0.000000	183.0	1.8	99.0	208	2.0	99.0					
9/13/2025	0.120100	0.036000	0.000000											
9/14/2025	0.126900	0.038100	0.000000											
9/15/2025	0.123700	0.037100	0.008840											
9/16/2025	0.118800	0.035600	0.008840											
9/17/2025	0.119500	0.035900	0.000000											
9/18/2025	0.111800	0.033500	0.000000											
9/19/2025	0.138600	0.041600	0.008840											
9/20/2025	0.118800	0.035600	0.000000											
9/21/2025	0.124000	0.037200	0.000000											
9/22/2025	0.128600	0.038600	0.000000											
9/23/2025	0.119500	0.035900	0.000000											
9/24/2025	0.116100	0.034800	0.008840											
9/25/2025	0.111700	0.033500	0.008840											
9/26/2025	0.124000	0.037200	0.000000											
9/27/2025	0.112800	0.033800	0.000000											
9/28/2025	0.128900	0.038700	0.000000											
9/29/2025	0.129200	0.038800	0.000000											
9/30/2025	0.127300	0.038200	0.008840											
Minimum	0.111700	0.033500	0.000000	183.0	1.8	95.3	208	2.0	95.3	7.17	8.68	<0.100	0.1	2,420
Maximum	0.158400	0.047500	0.008840	336.0	15.8	99.0	359	16.9	99.0	7.47	9.05	<0.100	0.1	2,420
Total	3.762800	1.128700	0.061880	519	17.6	194	566	18.9	194	14.6	17.7	0.200	0.2	4,840
Average	0.125427	0.037623	0.002063	259.5	8.8	97.2	283	9.5	97.2	7.32	8.87	0.100	0.1	2,420

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report for September, 2025

Date	Influent BOD (mg/l)	B01 CBOD (mg/l)	BOD % Removal (mg/l)	Influent BOD (lbs/day)	B01 CBOD (lbs/day)	BOD % Removal (lbs/day)	Electrical Usage (kwh's)	High Temperature (degrees F)	Low Temperature (degrees F)	Rainfall (inches)	Snowfall (inches)
9/1/2025							768	78.6	52.1		
9/2/2025							1,152	77.9	54.7		
9/3/2025							768	74.1	44.6	0.02	
9/4/2025	260.0	<4.00	98.5	278	4.3	98.5	1,152	66.8	49.8		
9/5/2025							1,152	67.7	43.5		
9/6/2025							1,152	68.6	41.3		
9/7/2025							768	69.7	41.3		
9/8/2025							1,152	73.8	45.5		
9/9/2025							384	76.2	49.2		
9/10/2025							1,152	83.1	53.6		
9/11/2025	140.0	<4.00	97.1	147	4.2	97.1	768	84.7	56.6		
9/12/2025							1,152	87.5	59.1		
9/13/2025							768	95.2	65.9		
9/14/2025							1,152	95.2	65.2		
9/15/2025							768	91.0	62.4		
9/16/2025							1,152	89.7	57.8		
9/17/2025							768	88.1	58.9		
9/18/2025							1,152	82.7	64.5		
9/19/2025							1,152	83.4	60.2		
9/20/2025							1,152	71.1	62.0	0.28	
9/21/2025							1,152	79.5	63.2		
9/22/2025							768	81.9	59.5	0.18	
9/23/2025							1,152	75.5	61.7		
9/24/2025							1,152	75.3	50.5	0.00	
9/25/2025							1,152	78.1	50.7		
9/26/2025							768	85.1	54.1		
9/27/2025							1,152	86.1	54.6		
9/28/2025							768	88.0	54.2		
9/29/2025							1,152	87.5	58.3		
9/30/2025											
Minimum	140.0	<4.00	97.1	147	4.2	97.1	384	66.8	41.3	0.00	0.0
Maximum	260.0	<4.00	98.5	278	4.3	98.5	1,152	95.2	65.9	0.28	0.0
Total	400.0	8.00	195.6	425	8.5	195.6	28,800	2,342	1,595	0.48	0.0
Average	200.0	4.00	97.8	213	4.3	97.8	993	80.8	55.0	0.12	

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report for September, 2025
 Outfall A01
 Excess Flow Discharge

Date	BOD (mg/l)	TSS (mg/l)	NH3 (as N) (mg/l)	Fecal Coliform (cfu's/100ml)	Flow (mgd)
9/1/2025					0.000000
9/2/2025					0.000000
9/3/2025					0.000000
9/4/2025					0.000000
9/5/2025					0.000000
9/6/2025					0.000000
9/7/2025					0.000000
9/8/2025					0.000000
9/9/2025					0.000000
9/10/2025					0.000000
9/11/2025					0.000000
9/12/2025					0.000000
9/13/2025					0.000000
9/14/2025					0.000000
9/15/2025					0.000000
9/16/2025					0.000000
9/17/2025					0.000000
9/18/2025					0.000000
9/19/2025					0.000000
9/20/2025					0.000000
9/21/2025					0.000000
9/22/2025					0.000000
9/23/2025					0.000000
9/24/2025					0.000000
9/25/2025					0.000000
9/26/2025					0.000000
9/27/2025					0.000000
9/28/2025					0.000000
9/29/2025					0.000000
9/30/2025					0.000000

Minimum					0.000000
Maximum					0.000000
Total					0.000000
Average					0.000000

Knoxville, Illinois Wastewater Treatment Plant
 Operated by Bock Inc.
 Monthly Report for September, 2025
 Outfall 001
 Excess Flow Discharge

Date	D.O. (mg/L)	BOD (mg/L)	pH (Std.Units)	TSS (mg/L)	NH3 (as N) (mg/L)	CL2 Residual (mg/L)	Flow (mgd)
09/01/25							0.158400
09/02/25							0.139400
09/03/25							0.141700
09/04/25							0.128000
09/05/25							0.135100
09/06/25							0.116000
09/07/25							0.121700
09/08/25							0.125000
09/09/25							0.115100
09/10/25							0.120100
09/11/25							0.125900
09/12/25							0.136100
09/13/25							0.120100
09/14/25							0.126900
09/15/25							0.123700
09/16/25							0.118800
09/17/25							0.119500
09/18/25							0.111800
09/19/25							0.138600
09/20/25							0.118800
09/21/25							0.124000
09/22/25							0.128600
09/23/25							0.119500
09/24/25							0.116100
09/25/25							0.111700
09/26/25							0.124000
09/27/25							0.112800
09/28/25							0.128900
09/29/25							0.129200
09/30/25							0.127300

Minimum							0.111700
Maximum							0.158400
Total							3.762800
Average							0.125427

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(g), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NPDES Reporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.410(h)(4). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per outlet. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit #: IL0022209 Major: No		Permittee: KNOXVILLE CITY OF Permittee Address: 33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61148		Facility: KNOXVILLE STP, CITY OF Facility Location: 507 SOUTH DIVISION STREET KNOXVILLE, IL 61148																																																																																						
Report Dates & Status: From 09/01/25 to 09/30/25 Monitoring Period: From 09/01/25 to 09/30/25 Considerations for Form Completion: BOW ID: W095300002 Principal Executive Officer: Stanley Bockewitz First Name: Stanley Last Name: Bockewitz No Data Indicator (NODI): No Data Indicator (NODI)		Discharge: INFIL INFLUENT MONITORING Discharge Date: 10/25/25 Status: NoDMR Validated		Title: Chief Operator Telephone: 309-554-3033																																																																																						
Form NODI:																																																																																										
<table border="1"> <thead> <tr> <th>Code</th> <th>Parameter Name</th> <th>Monitoring Location</th> <th>Season #</th> <th>Permit NODI</th> <th>Sample Permit Fee</th> <th>Quantity 1</th> <th>Value 1</th> <th>Quantity 2</th> <th>Value 2</th> <th>Units</th> <th>Qualifier 1</th> <th>Value 1</th> <th>Qualifier 2</th> <th>Value 2</th> <th>Units</th> <th>Qualifier 3</th> <th>Value 3</th> <th># of Ex.</th> <th>Frequency of Analysis</th> <th>Sample Type</th> </tr> </thead> <tbody> <tr> <td>00310</td> <td>GOD, 5-day, 20 deg C</td> <td>G - Raw Sewage Influent</td> <td>0</td> <td>-</td> <td>Sample Permit Fee</td> <td>0.135427</td> <td>0.135427</td> <td>0.1354</td> <td>0.1354</td> <td>03 - MGD</td> <td>2000</td> <td>2000</td> <td>2000</td> <td>2000</td> <td>18 - mg/L</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>00330</td> <td>Solids, total suspended</td> <td>G - Raw Sewage Influent</td> <td>0</td> <td>-</td> <td>Sample Permit Fee</td> <td>0.135427</td> <td>0.135427</td> <td>0.1354</td> <td>0.1354</td> <td>03 - MGD</td> <td>2000</td> <td>2000</td> <td>2000</td> <td>2000</td> <td>18 - mg/L</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> </tr> <tr> <td>50050</td> <td>Flow, in conduit or thru treatment plant</td> <td>G - Raw Sewage Influent</td> <td>0</td> <td>-</td> <td>Sample Permit Fee</td> <td>0.135427</td> <td>0.135427</td> <td>0.1354</td> <td>0.1354</td> <td>03 - MGD</td> <td>2000</td> <td>2000</td> <td>2000</td> <td>2000</td> <td>18 - mg/L</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> <td>0</td> </tr> </tbody> </table>						Code	Parameter Name	Monitoring Location	Season #	Permit NODI	Sample Permit Fee	Quantity 1	Value 1	Quantity 2	Value 2	Units	Qualifier 1	Value 1	Qualifier 2	Value 2	Units	Qualifier 3	Value 3	# of Ex.	Frequency of Analysis	Sample Type	00310	GOD, 5-day, 20 deg C	G - Raw Sewage Influent	0	-	Sample Permit Fee	0.135427	0.135427	0.1354	0.1354	03 - MGD	2000	2000	2000	2000	18 - mg/L	0	0	0	0	0	0	00330	Solids, total suspended	G - Raw Sewage Influent	0	-	Sample Permit Fee	0.135427	0.135427	0.1354	0.1354	03 - MGD	2000	2000	2000	2000	18 - mg/L	0	0	0	0	0	50050	Flow, in conduit or thru treatment plant	G - Raw Sewage Influent	0	-	Sample Permit Fee	0.135427	0.135427	0.1354	0.1354	03 - MGD	2000	2000	2000	2000	18 - mg/L	0	0	0	0	0
Code	Parameter Name	Monitoring Location	Season #	Permit NODI	Sample Permit Fee	Quantity 1	Value 1	Quantity 2	Value 2	Units	Qualifier 1	Value 1	Qualifier 2	Value 2	Units	Qualifier 3	Value 3	# of Ex.	Frequency of Analysis	Sample Type																																																																						
00310	GOD, 5-day, 20 deg C	G - Raw Sewage Influent	0	-	Sample Permit Fee	0.135427	0.135427	0.1354	0.1354	03 - MGD	2000	2000	2000	2000	18 - mg/L	0	0	0	0	0	0																																																																					
00330	Solids, total suspended	G - Raw Sewage Influent	0	-	Sample Permit Fee	0.135427	0.135427	0.1354	0.1354	03 - MGD	2000	2000	2000	2000	18 - mg/L	0	0	0	0	0																																																																						
50050	Flow, in conduit or thru treatment plant	G - Raw Sewage Influent	0	-	Sample Permit Fee	0.135427	0.135427	0.1354	0.1354	03 - MGD	2000	2000	2000	2000	18 - mg/L	0	0	0	0	0																																																																						
Submitter Note: If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.																																																																																										
Edit Check Errors: No errors.																																																																																										
Comments:																																																																																										
Attachments: No attachments.																																																																																										
Report Last Saved By: KNOXVILLE CITY OF																																																																																										
User: bockewitz1992																																																																																										
Name: Stanley Bockewitz																																																																																										
E-Mail: stanb@bockewitz.net																																																																																										
Date Time: 2025-10-15 11:46 (Time Zone: -05:00)																																																																																										
Report Last Signed By: bockewitz1992																																																																																										
User: Stanley Bockewitz																																																																																										
Name: Stanley Bockewitz																																																																																										
E-Mail: stanb@bockewitz.net																																																																																										

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the DMRs/Recordkeeping Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(i)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per outfall. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit #: IL0022209 Major: No Permitted Feature: B01 Internal Outfall Report Dates & Status: From 08/01/25 to 09/30/25 Monitoring Period: From 08/01/25 to 09/30/25 Considerations for Form Completion: BOW ID: W050300002 Principal Executive Officer: Stanley Bockwitz First Name: Stanley Last Name: Bockwitz No Data Indicator (NODI): 1 Form NODI: 1		Permittee: KNOXVILLE, CITY OF Permittee Address: 33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61448 Discharge: B01.0 STP INTERNAL OUTFALL DMR Due Date: 10/25/25 Status: NADMR Validated Facility Location: KNOXVILLE STP, CITY OF 507 SOUTH DIVISION STREET KNOXVILLE, IL 61448 Telephone: 309-354-3033														
Code Parameter Name Monitoring Location Season Form NODI Sample Permit Reg. Value Quantity or Loading Units Concentration Value 1 Value 2 Quality or Concentration Value 3 Units Freq. of Analysis Sample Type																
00300	Oxygen, dissolved [DO]	1 - Effluent Gross	1	-	Sample Permit Reg. Value	7.17	=	7.47					12 - SU	02200 - Twice Per Month	GR - Grab	
00400	pH	1 - Effluent Gross	0	-	Sample Permit Reg. Value	8.0	>=	MINIMUM					12 - SU	02200 - Twice Per Month	GR - Grab	
00500	Solids, total suspended	1 - Effluent Gross	0	-	Sample Permit Reg. Value	3.5	=	16.9	26 - lb/d				19 - mg/L	02200 - Twice Per Month	CP - Composite	
					Permit Reg. Value	165.0	MO AVG	<=	330.0	DAILY MAX	26 - lb/d		19 - mg/L	0	02200 - Twice Per Month	CP - Composite
00610	Nitrogen, ammonia total [as N]	1 - Effluent Gross	0	-	Sample Permit Reg. Value	0.1	=	0.1	26 - lb/d				19 - mg/L	02200 - Twice Per Month	CP - Composite	
					Permit Reg. Value	15.0	MO AVG	<=	61.2	DAILY MAX	26 - lb/d		19 - mg/L	0	02200 - Twice Per Month	CP - Composite
00610	Nitrogen, ammonia total [as N]	8 - Other Treatment Process	0	-	Sample Permit Reg. Value	0.1	=	0.1	26 - lb/d				19 - mg/L	02200 - Twice Per Month	CP - Composite	
					Permit Reg. Value	48.0	WEEKLY AVG	<=	48.0	WEEKLY AVG	26 - lb/d		19 - mg/L	0	02200 - Twice Per Month	CP - Composite
50050	Flow, in conduit or thru treatment plant	1 - Effluent Gross	0	-	Sample Permit Reg. Value	0.125427	=	0.1584	MGD				36896 - Continuous	98989 - Continuous	GR - Grab	
					Permit Reg. Value	10.0	MO AVG	<=	10.0	DAILY MAX	MGD		36896 - Continuous	98989 - Continuous	GR - Grab	
50060	Chlorine, total residual	1 - Effluent Gross	0	-	Sample Permit Reg. Value	0.05	DAILY MAX	<=	0.05	DAILY MAX	19 - mg/L		CLDCC - Chlorine/Chloramines	GR - Grab		

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2028

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NEPUS Accrediting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.410(k)(1). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per output. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit: Permit #: IL0022209 Major: No		Permittee: Permittee Address: KNOXVILLE, CITY OF 33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61148		Facility: Facility Location: KNOXVILLE STP, CITY OF 507 SOUTH DIVISION STREET KNOXVILLE, IL 61148							
Permitted Feature: Report Dates & Status: From 09/01/25 to 09/30/25 Monitoring Period: From 09/01/25 to 09/30/25 Considerations for Farm Completion: BOW ID: W0960300002; NUMBER OF DAYS OF DISCHARGE: Principal Executive Officer: Stanley Sockewitz		Discharge: Discharge: A01-0 EXCESS FLOW DMR Due Date: 10/25/25		Status: Status: Not DMR Validated							
First Name: Stanley Last Name: Sockewitz No Data Indicator (NOD): - Form NOD: -		Title: Chief Operator Telephone: 309-554-4033									
Code	Parameter Name	Monitoring Location	Season #	Param. NOD	Sample Permit Req.	Quantity of Loading	Quality of Concentration	Units	# of Ex.	Frequency of Analysis	Sample Type
						Qualifier 1	Value 1	Qualifier 2	Value 2	Qualifier 3	Value 3
00310	BOD, 5-day, 20 deg. C	1 - Effluent Gross	0	-	Sample Permit Req.	Req Mon MO AVG	C - No Discharge	19 - mg/L	DLDS - Daily When Discharging	GR - Grab	
00350	Solids, total suspended	1 - Effluent Gross	0	-	Sample Permit Req.	Req Mon MO AVG	C - No Discharge	19 - mg/L	DLDS - Daily When Discharging	GR - Grab	
00610	Nitrogen, ammonia total [as N]	1 - Effluent Gross	0	-	Sample Permit Req.	Req Mon DAILY MAX	C - No Discharge	19 - mg/L	DLDS - Daily When Discharging	GR - Grab	
74065	Coliform, fecal general	1 - Effluent Gross	0	-	Sample Permit Req.	Req Mon DAILY MAX	C - No Discharge	13 - #/100mL	DLDS - Daily When Discharging	GR - Grab	
82220	Flow, total	1 - Effluent Gross	0	-	Sample Permit Req.	Req Mon MO TOTAL	80 - Mgal/mo		DLDS - Daily When Discharging	CN - Continuous	

Submission Note
 If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors
 No errors.

Comments

Attachments
 No attachments.

Report Last Saved By
 KNOXVILLE CITY OF

User:

Name:

E-Mail:

bookinc1992

Stanley Sockewitz

stanb@bookinc.net

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2028

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable unless it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the MEDS Accrediting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3507 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(i)(4)(v). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per report, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, reviewing and collecting the data, and completing and reviewing the collection of information. Send comments on this burden estimate and any suggested method for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2827T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit #: IL0022203		Permittee: KNOXVILLE, CITY OF		Facility: KNOXVILLE STP, CITY OF					
Major: No		Permittee Address: 23 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61448		Facility Location: 507 SOUTH DIVISION STREET KNOXVILLE, IL 61448					
Permitted Feature: 001 External Outfall		Discharge: 001-d COMBINED DISCHARGE FROM A01 AND B01		Status: NeedMIR Validated					
Report Dates & Status: Monitoring Period: From 09/01/25 to 09/30/25		DMR Due Date: 10/29/25							
Considerations for Form Completion: ROW ID: W095030002, NUMBER OF DAYS OF DISCHARGE:									
Principal Executive Officer: Stanley Borkewitz		Chief Operator: 		Telephone: 306-654-3033					
First Name: Stanley									
Last Name: Borkewitz									
No Data Indicator (NODI): -									
Form NODI: -									
Code	Parameter Name	Monitoring Location	Season	Param. NODI	Quantity or Loading	Quality or Concentration	Frequency of Analysis	Sample Type	
					Qualifier 1 Value 1	Qualifier 2 Value 2	Qualifier 1 Value 1	Qualifier 2 Value 2	
00380	Oxygen, dissolved (DO)	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	Req Mon MO AVG C - No Discharge	Req Mon MN Wk AV C - No Discharge	Req Mon DAILY MIN C - No Discharge	19 - mg/L DLOS - Daily When Discharging GR - Grab
00310	BOD, 5-day, C	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	Req Mon MO AVG C - No Discharge	Req Mon MN Wk AV C - No Discharge	Req Mon DAILY MIN C - No Discharge	19 - mg/L DLOS - Daily When Discharging GR - Grab
00400	pH	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	Req Mon MO AVG C - No Discharge	Req Mon MN Wk AV C - No Discharge	Req Mon DAILY MIN C - No Discharge	12 - SU DLOS - Daily When Discharging GR - Grab
00530	Solids, total suspended	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	Req Mon MO AVG C - No Discharge	Req Mon MN Wk AV C - No Discharge	Req Mon DAILY MIN C - No Discharge	19 - mg/L DLOS - Daily When Discharging GR - Grab
00610	Nitrogen, ammonia total (as N)	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	Req Mon MO AVG C - No Discharge	Req Mon MN Wk AV C - No Discharge	Req Mon DAILY MIN C - No Discharge	19 - mg/L DLOS - Daily When Discharging GR - Grab
30060	Chlorine, total residual	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	Req Mon MO AVG C - No Discharge	Req Mon MN Wk AV C - No Discharge	Req Mon DAILY MIN C - No Discharge	19 - mg/L DLOS - Daily When Discharging GR - Grab
62220	Flow, total	1 - Effluent Gross	0	-	Sample Permit Req. Value NODI	Req Mon MO TOTAL C - No Discharge	Req Mon MN Wk AV C - No Discharge	Req Mon DAILY MIN C - No Discharge	DLOS - Daily When Discharging CN - Continuous

Submission Note
If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors
No errors.

Comments

Attachments