RECEIVED
NOV 10 2026
CITY OF KNOXVILLE

BOCK INC.

MONTHLY REPORT FOR OCTOBER, 2026

SUBMITTED BY: ***SB***

October, 2026

IEPA SUMMARY

There were no communications with IEPA.

MAINTENANCE SUMMARY

BOCK Inc. performed all preventive maintenance for the plant.

SAFETY

Because safety is an important part of our daily practice, we have been without a loss time injury at the plant for 304 months.

OPERATIONS SUMMARY

Influent flow averaged .5225 gallons per day.

Electricity used totaled 39,552 kilowatt hours.

Rainfall totaled 4.94 inches.


Dewatered sludge disposed of to the Knox County landfill totaled 0 tons.


Knoxville, Illinois
Wastewater Treatment Plant
Twelve Month Moving Average Report
Submitted by
Bock Inc.


	Date	Influent - Daily Average Flow (gallons per day)	Total Electrical Usage (kilowatt hours)	Total Rainfall (inches)
1	January 2026	123,123	61,440	0.88
2	February 2026	92,811	42,240	0.08
3	March 2026	579,616	39,168	5.48
4	April 2026	935,427	30,336	5.45
5	May 2026	446,530	26,496	1.21
6	June 2026	670,250	28,416	9.57
7	July 2026	192,184	27,264	1.76
8	August 2026	452,355	30,720	7.76
9	September 2026	280,630	33,792	4.93
10	October 2026	522,552	39,552	4.94
11	November 2025	133,353	46,464	3.08
12	December 2025	143,723	64,896	5.50
Total		4,572,554	470,784	50.64
Average		703,470	72,428	4.22

Plant Design Average Flow is
660,000 gallons per day

Plant Design Maximum Flow is
1,650,000 gallons per day

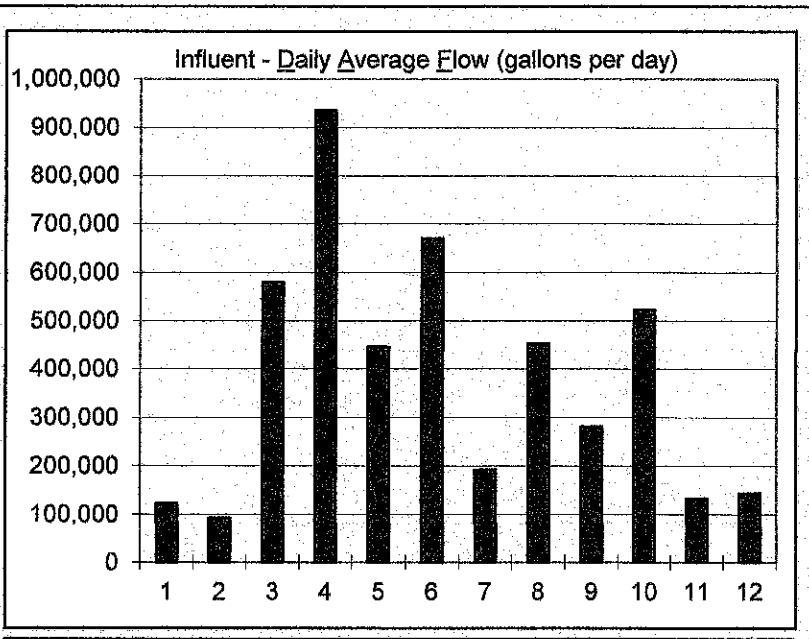

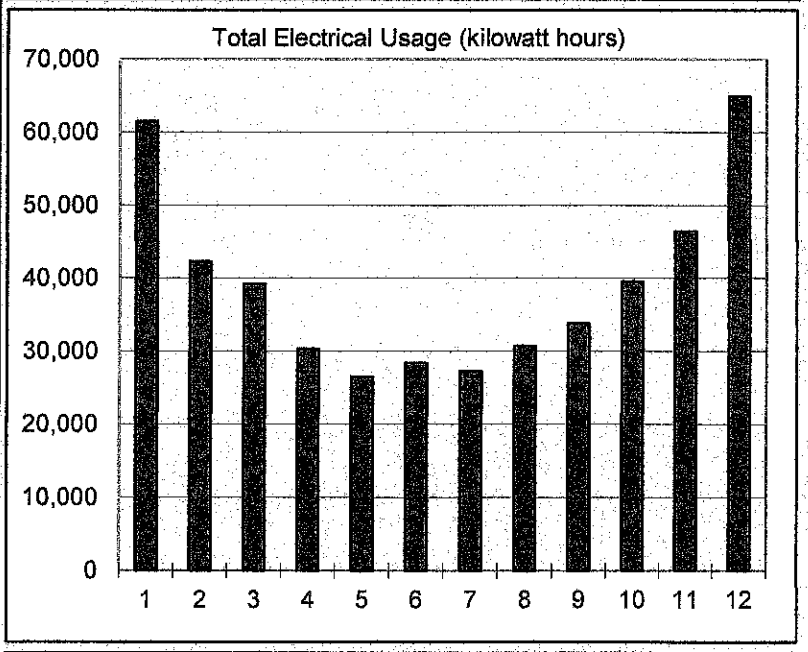

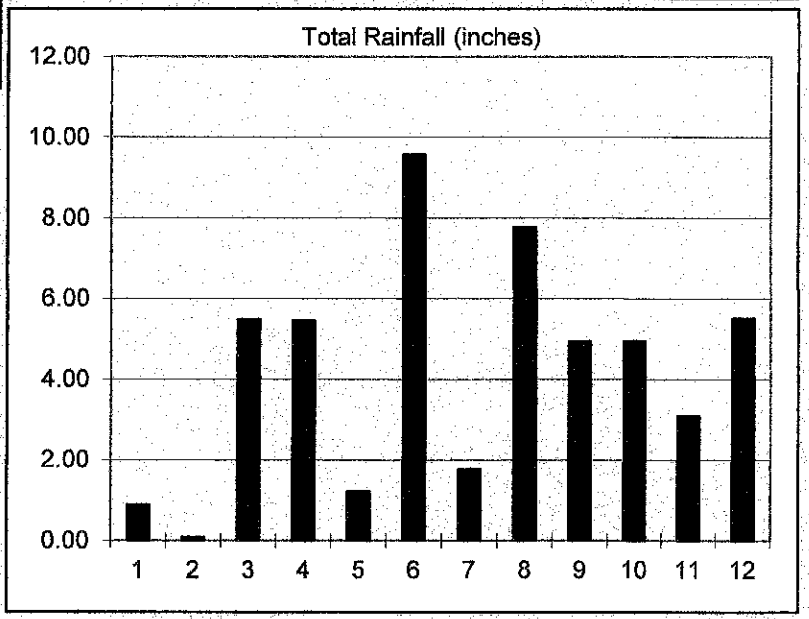

Knoxville, Illinois Wastewater Treatment Plant
Operated by Bock Inc.
Monthly Report October, 2026

Date	Influent Flow (mgd)	RAS Flow (mgd)	WAS Flow (mgd)	Influent TSS (mg/l)	B01 TSS (mg/l)	TSS % Removal (mg/l)	Influent TSS (lbs/day)	B01 TSS (lbs/day)	TSS % Removal (lbs/day)	Outfall B01 pH (std. units)	D.O. (mg/l)	NH3 as (N) (mg/l)	NH3 as (N) (lbs/day)	Fecal Coliform (cfu/100)
10/1/2026	1.604800	0.481400	0.000000											
10/2/2026	1.385500	0.415700	0.008840	18.0			208							
10/3/2026	1.282200	0.384700	0.000000											
10/4/2026	1.098500	0.329600	0.000000											
10/5/2026	0.909000	0.272700	0.008840											
10/6/2026	0.653000	0.195900	0.000000											
10/7/2026	0.538000	0.161400	0.008840											
10/8/2026	0.476100	0.142800	0.000000											
10/9/2026	0.710000	0.213000	0.008840	48.0	4.6	90.4	284	27.2	90.4	8.24	8.49	0.100	0.6	2,420
10/10/2026	0.461700	0.138500	0.000000											
10/11/2026	0.438400	0.131500	0.000000											
10/12/2026	0.424300	0.127300	0.008840											
10/13/2026	0.448600	0.134600	0.000000											
10/14/2026	0.409600	0.122900	0.000000											
10/15/2026	0.491900	0.147600	0.000000							8.14	8.32	0.100	0.4	2,420
10/16/2026	0.399700	0.119900	0.008840	50	4.4	91.2	167	14.7	91.2					
10/17/2026	0.319600	0.095900	0.000000											
10/18/2026	0.358300	0.107500	0.000000											
10/19/2026	0.311400	0.093400	0.000000											
10/20/2026	0.288200	0.086500	0.000000											
10/21/2026	0.289600	0.086900	0.000000											
10/22/2026	0.290700	0.087200	0.008840											
10/23/2026	0.261100	0.078300	0.000000											
10/24/2026	0.300200	0.090100	0.000000											
10/25/2026	0.297300	0.089200	0.000000											
10/26/2026	0.261700	0.078500	0.000000											
10/27/2026	0.205400	0.061600	0.000000											
10/28/2026	0.200000	0.060000	0.000000											
10/29/2026	0.203000	0.060900	0.000000											
10/30/2026	0.443600	0.133100	0.000000											
10/31/2026	0.437700	0.131300	0.000000											
Minimum	0.200000	0.060000	0.000000	18.0	4.4	90.4	167	14.7	90.4	8.14	8.32	<0.100	0.4	2,420
Maximum	1.604800	0.481400	0.008840	50.0	4.6	91.2	284	27.2	91.2	8.24	8.49	<0.100	0.6	2,420
Total	16.199100	4.859900	0.061880	116	9.0	182	659	41.9	182	16.4	16.8	0.200	1.0	4,840
Average	0.522552	0.156771	0.001996	38.7	4.5	90.8	220	21.0	90.8	8.19	8.41	0.100	0.5	2,420

Knoxville, Illinois Wastewater Treatment Plant
Operated by Bock Inc.
Monthly Report for October, 2026

Date	Influent BOD (mg/l)	B01 CBOD (mg/l)	BOD % Removal (mg/l)	Influent BOD (lbs/day)	B01 CBOD (lbs/day)	BOD % Removal (lbs/day)	Electrical Usage (kwh's)	High Temperature (degrees F)	Low Temperature (degrees F)	Rainfall (inches)	Snowfall (inches)
10/1/2026							1,536	70.8	51.5	2.67	
10/2/2026							1,152	68.5	45.9		
10/3/2026							1,536	71.6	47.3		
10/4/2026							1,152	75.3	43.7		
10/5/2026							1,152	73.6	46.4		
10/6/2026							1,152	76.9	50.5		
10/7/2026							1,152	82.2	47.9		
10/8/2026							1,152	79.3	51.9	0.38	
10/9/2026	180	<4.00	97.8	1,066	23.7	97.8	1,536	79.0	53.7	0.19	
10/10/2026							1,152	81.3	51.0		
10/11/2026							1,152	81.2	55.8		
10/12/2026							768	86.9	65.8		
10/13/2026							1,152	83.8	63.3	0.41	
10/14/2026							1,152	68.1	59.0		
10/15/2026	210.0	<4.00	98.1	862	16.4	98.1	1,536	66.5	44.6	0.25	
10/16/2026							1,536	53.9	33.3	0.07	
10/17/2026							1,536	56.7	38.8		
10/18/2026							1,152	64.0	37.7		
10/19/2026							1,152	69.4	39.8		
10/20/2026							1,152	71.1	41.7		
10/21/2026							1,152	73.6	45.5		
10/22/2026							1,536	76.1	47.2		
10/23/2026							1,152	74.1	47.9		
10/24/2026							1,152	73.5	46.3		
10/25/2026							1,536	77.1	49.4		
10/26/2026							1,152	76.0	50.6		
10/27/2026							1,152	68.1	51.0		
10/28/2026							1,152	76.5	52.7		
10/29/2026							1,152	70.8	43.9		
10/30/2026							1,920	59.9	49.5	0.96	
10/31/2026							1,536	61.3	53.3	0.01	

Minimum	180.0	<4.00	97.8	862	16.4	97.8	768	53.9	33.3	0.01	0.0
Maximum	210.0	<4.00	98.1	1,066	23.7	98.1	1,920	86.9	65.8	2.67	0.0
Total	390.0	8.00	195.9	1,927	40.1	195.9	39,552	2,247	1,507	4.94	0.0
Average	195.0	4.00	98.0	964	20.1	98.0	1,276	72.5	48.6	0.62	

Knoxville, Illinois Wastewater Treatment Plant
Operated by Bock Inc.
Monthly Report for October, 2026
Outfall A01
Excess Flow Discharge

Date	BOD (mg/l)	TSS (mg/l)	NH3 (as N) (mg/l)	Fecal Coliform (cfu's/100ml)	Flow (mgd)
10/1/2026					0.000000
10/2/2026	12.0	16.0	0.61	30	1.272000
10/3/2026					0.000000
10/4/2026					0.000000
10/5/2026					0.000000
10/6/2026					0.000000
10/7/2026					0.000000
10/8/2026					0.000000
10/9/2026					0.000000
10/10/2026					0.000000
10/11/2026					0.000000
10/12/2026					0.000000
10/13/2026					0.000000
10/14/2026					0.000000
10/15/2026					0.000000
10/16/2026					0.000000
10/17/2026					0.000000
10/18/2026					0.000000
10/19/2026					0.000000
10/20/2026					0.000000
10/21/2026					0.000000
10/22/2026					0.000000
10/23/2026					0.000000
10/24/2026					0.000000
10/25/2026					0.000000
10/26/2026					0.000000
10/27/2026					0.000000
10/28/2026					0.000000
10/29/2026					0.000000
10/30/2026					0.000000
10/31/2026					0.000000

Minimum	12.00	16.0	0.61	29.8	0.000000
Maximum	12.00	16.0	0.61	29.8	1.272000
Total	12.00	16.0	0.61	29.8	1.272000
Average	12.00	16.0	0.61	29.8	0.041032

Knoxville, Illinois Wastewater Treatment Plant
Operated by Bock Inc.
Monthly Report for October, 2026
Outfall 001
Excess Flow Discharge

Date	D.O. (mg/L)	BOD (mg/L)	pH (Std.Units)	TSS (mg/L)	NH3 (as N) (mg/L)	CL2 Residual (mg/L)	Flow (mgd)
10/01/26							1.604800
10/02/26	8.81	4.1	7.98	13.6	1.00	0.49	2.657500
10/03/26							1.282200
10/04/26							1.098500
10/05/26							0.909000
10/06/26							0.653000
10/07/26							0.538000
10/08/26							0.476100
10/09/26							0.710000
10/10/26							0.461700
10/11/26							0.438400
10/12/26							0.424300
10/13/26							0.448600
10/14/26							0.409600
10/15/26							0.491900
10/16/26							0.399700
10/17/26							0.319600
10/18/26							0.358300
10/19/26							0.311400
10/20/26							0.288200
10/21/26							0.289600
10/22/26							0.290700
10/23/26							0.261100
10/24/26							0.300200
10/25/26							0.297300
10/26/26							0.261700
10/27/26							0.205400
10/28/26							0.200000
10/29/26							0.203000
10/30/26							0.443600
10/31/26							0.437700

Minimum	8.81	4.10	7.98	13.6	1.00	0.49	0.200000
Maximun	8.81	4.10	7.98	13.6	1.00	0.49	2.657500
Total	8.81	4.10	7.98	13.6	1.00	0.49	17.471100
Average	8.81	4.10	7.98	13.6	1.00	0.49	0.563584

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NPDES eReporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(l)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per outfall. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit

Permit #:	**IL0022209**	**Permittee:**	KNOXVILLE, CITY OF	**Facility:**	KNOXVILLE STP, CITY OF
Major:	No	**Permittee Address:**	33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61448	**Facility Location:**	507 SOUTH DIVISION STREET KNOXVILLE, IL 61448
Permitted Feature:	001 External Outfall	**Discharge:**	**001-0** COMBINED DISCHARGE FROM A01 AND B01		

Report Dates & Status

Monitoring Period:	**From 10/01/26 to 10/31/26**	**DMR Due Date:**	**11/25/26**	**Status:**	**NetDMR Validated**

Considerations for Form Completion

BOW ID: W0950300002; NUMBER OF DAYS OF DISCHARGE:

Principal Executive Officer

First Name:	Ty	**Title:**	Chief Operator	**Telephone:**	309-854-3520
Last Name:	Cruse				

No Data Indicator (NODI)

Form NODI: –

Parameter Code	Parameter Name	Monitoring Location	Season #	Param. NODI		Quantity or Loading Qualifier 1	Value 1	Qualifier 2	Value 2	Units	Quality or Concentration Qualifier 1	Value 1	Qualifier 2	Value 2	Qualifier 3	Value 3	Units	# of Ex.	Frequency of Analysis	Sample Type
00300	**Oxygen, dissolved [DO]**	1 - Effluent Gross	0	–	Sample						=	8.81	=	8.81	=	8.81	19 - mg/L		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.							Req Mon MO AV MN		Req Mon MN WK AV		Req Mon DAILY MN	19 - mg/L	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
00310	**BOD, 5-day, 20 deg. C**	1 - Effluent Gross	0	–	Sample						=	4.1	=	4.1			19 - mg/L		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.						<=	30.0 MO AVG	<=	45.0 WKLY AVG			19 - mg/L	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
00400	**pH**	1 - Effluent Gross	0	–	Sample						=	7.98			=	7.98	12 - SU		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.						>=	6.0 MINIMUM			<=	9.0 MAXIMUM	12 - SU	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
00530	**Solids, total suspended**	1 - Effluent Gross	0	–	Sample						=	13.6	=	13.6			19 - mg/L		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.						<=	30.0 MO AVG	<=	45.0 WKLY AVG			19 - mg/L	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
00610	**Nitrogen, ammonia total [as N]**	1 - Effluent Gross	0	–	Sample								=	1.0	=	1.0	19 - mg/L		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.									Req Mon MO AVG		Req Mon DAILY MX	19 - mg/L	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
50060	**Chlorine, total residual**	1 - Effluent Gross	0	–	Sample								=	0.49			19 - mg/L		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.								<=	0.75 MO AVG			19 - mg/L	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
82220	**Flow, total**	1 - Effluent Gross	0	–	Sample	=	2.657			80 - Mgal/mo									DL/DS - Daily When Discharging	CN - Continuous
					Permit Req.		Req Mon MO TOTAL			80 - Mgal/mo								0	DL/DS - Daily When Discharging	CN - Continuous
					Value NODI															

Submission Note

If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors

No errors.

Comments

Discharge from 08:00 10-1-26 through 08:00 10-2-26

Attachments

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NPDES eReporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(l)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per outfall. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit

Permit #:	IL0022209	Permittee:	KNOXVILLE, CITY OF	Facility:	KNOXVILLE STP, CITY OF
Major:	No	Permittee Address:	33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61448	Facility Location:	507 SOUTH DIVISION STREET KNOXVILLE, IL 61448
Permitted Feature:	A01 External Outfall	Discharge:	A01-0 EXCESS FLOW		

Report Dates & Status

Monitoring Period:	From 10/01/26 to 10/31/26	DMR Due Date:	11/25/26	Status:	NetDMR Validated

Considerations for Form Completion

BOW ID: W0950300002; NUMBER OF DAYS OF DISCHARGE:

Principal Executive Officer

First Name:	Ty	Title:	Chief Operator	Telephone:	309-854-3520
Last Name:	Cruse				

No Data Indicator (NODI)

Form NODI: –

Parameter Code	Parameter Name	Monitoring Location	Season #	Param. NODI		Quantity or Loading Qualifier 1	Value 1	Qualifier 2	Value 2	Units	Quality or Concentration Qualifier 1	Value 1	Qualifier 2	Value 2	Qualifier 3	Value 3	Units	# of Ex.	Frequency of Analysis	Sample Type
00310	BOD, 5-day, 20 deg. C	1 - Effluent Gross	0	–	Sample								=	12.0			19 - mg/L		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.									Req Mon MO AVG			19 - mg/L	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
00530	Solids, total suspended	1 - Effluent Gross	0	–	Sample								=	16.0			19 - mg/L		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.									Req Mon MO AVG			19 - mg/L	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
00610	Nitrogen, ammonia total [as N]	1 - Effluent Gross	0	–	Sample										=	0.61	19 - mg/L		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.											Req Mon DAILY MX	19 - mg/L	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
74055	Coliform, fecal general	1 - Effluent Gross	0	–	Sample										=	30.0	13 - #/100mL		DL/DS - Daily When Discharging	GR - Grab
					Permit Req.										<=	400.0 DAILY MX	13 - #/100mL	0	DL/DS - Daily When Discharging	GR - Grab
					Value NODI															
82220	Flow, total	1 - Effluent Gross	0	–	Sample			=	1.272	80 - Mgal/mo									DL/DS - Daily When Discharging	CN - Continuous
					Permit Req.				Req Mon MO TOTAL	80 - Mgal/mo									DL/DS - Daily When Discharging	CN - Continuous
					Value NODI															

Submission Note

If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors

No errors.

Comments

Discharge from 08:00 10-01-26 through 10-2-26 at 08:00.

Attachments

No attachments.

Report Last Saved By

KNOXVILLE, CITY OF

User: RYANTY243

Name: Ty Cruse

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NPDES eReporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(l)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per outfall. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit

Permit #:	IL0022209	Permittee:	KNOXVILLE, CITY OF	Facility:	KNOXVILLE STP, CITY OF
Major:	No	Permittee Address:	33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61448	Facility Location:	507 SOUTH DIVISION STREET KNOXVILLE, IL 61448
Permitted Feature:	B01 Internal Outfall	Discharge:	**B01-0** INTERNAL OUTFALL		

Report Dates & Status

Monitoring Period:	**From 10/01/25 to 10/31/25**	DMR Due Date:	**11/25/26**	Status:	**NetDMR Validated**

Considerations for Form Completion

BOW ID: W0950300002

Principal Executive Officer

First Name:	Ty	Title:	Chief Operator	Telephone:	309-854-3520
Last Name:	Cruse				

No Data Indicator (NODI)

Form NODI: –

Code	Parameter Name	Monitoring Location	Season #	Param. NODI		Quantity or Loading Qualifier 1	Value 1	Qualifier 2	Value 2	Units	Quality or Concentration Qualifier 1	Value 1	Qualifier 2	Value 2	Qualifier 3	Value 3	Units	# of Ex.	Frequency of Analysis	Sample Type
00300	**Oxygen, dissolved [DO]**	1 - Effluent Gross	1	–	Sample						=	8.41	=	8.32	=	8.32	19 - mg/L		02/30 - Twice Per Month	GR - Grab
					Permit Req.						>=	5.5 MO AV MN	>=	4.0 MN WK AV	>=	3.5 DAILY MN	19 - mg/L	0	02/30 - Twice Per Month	GR - Grab
					Value NODI															
00400	**pH**	1 - Effluent Gross	0	–	Sample						=	8.14			=	8.24	12 - SU		02/30 - Twice Per Month	GR - Grab
					Permit Req.						>=	6.0 MINIMUM			<=	9.0 MAXIMUM	12 - SU	0	02/30 - Twice Per Month	GR - Grab
					Value NODI															
00530	**Solids, total suspended**	1 - Effluent Gross	0	–	Sample	=	21.0	=	27.2	26 - lb/d			=	4.5	=	4.6	19 - mg/L		02/30 - Twice Per Month	CP - Composite
					Permit Req.	<=	165.0 MO AVG	<=	330.0 DAILY MX	26 - lb/d			<=	12.0 MO AVG	<=	24.0 DAILY MX	19 - mg/L	0	02/30 - Twice Per Month	CP - Composite
					Value NODI															
00610	**Nitrogen, ammonia total [as N]**	1 - Effluent Gross	0	–	Sample	=	0.5	=	0.6	26 - lb/d			<	0.1	<	0.1	19 - mg/L		02/30 - Twice Per Month	CP - Composite
					Permit Req.	<=	19.0 MO AVG	<=	61.0 DAILY MX	26 - lb/d			<=	1.4 MO AVG	<=	4.4 DAILY MX	19 - mg/L	0	02/30 - Twice Per Month	CP - Composite
					Value NODI															
00610	**Nitrogen, ammonia total [as N]**	8 - Other Treatment, Process Complete	0	–	Sample			=	0.6	26 - lb/d					<	0.1	19 - mg/L		02/30 - Twice Per Month	CP - Composite
					Permit Req.			<=	48.0 WKLY AVG	26 - lb/d					<=	3.5 WKLY AVG	19 - mg/L	0	02/30 - Twice Per Month	CP - Composite
					Value NODI															
50050	**Flow, in conduit or thru treatment plant**	1 - Effluent Gross	0	–	Sample	=	0.522552	=	1.6046	03 - MGD									99/99 - Continuous	
					Permit Req.		Req Mon MO AVG		Req Mon DAILY MX	03 - MGD								0	99/99 - Continuous	
					Value NODI															
50060	**Chlorine, total residual**	1 - Effluent Gross	0	–	Sample															
					Permit Req.										<=	0.05 DAILY MX	19 - mg/L		CL/OC - Chlorination /Occurances	GR - Grab
					Value															

9 - Conditional Monitoring - Not Required This

DMR Copy of Record

Form Approved OMB No. 2040-0004 expires on 07/31/2026

EPA may make all the information submitted through this form (including all attachments) available to the public without further notice to you. Do not use this online form to submit personal information (e.g., non-business cell phone number or non-business email address), confidential business information (CBI), or if you intend to assert a CBI claim on any of the submitted information. Pursuant to 40 CFR 2.203(a), EPA is providing you with notice that all CBI claims must be asserted at the time of submission. EPA cannot accommodate a late CBI claim to cover previously submitted information because efforts to protect the information are not administratively practicable since it may already be disclosed to the public. Although we do not foresee a need for persons to assert a claim of CBI based on the types of information requested in this form, if persons wish to assert a CBI claim we direct submitters to contact the NPDES eReporting Help Desk for further guidance. Please note that EPA may contact you after you submit this report for more information.

This collection of information is approved by OMB under the Paperwork Reduction Act, 44 U.S.C. 3501 et seq. (OMB Control No. 2040-0004). Responses to this collection of information are mandatory in accordance with this permit and EPA NPDES regulations 40 CFR 122.41(l)(4)(i). An agency may not conduct or sponsor, and a person is not required to respond to, a collection of information unless it displays a currently valid OMB control number. The public reporting and recordkeeping burden for this collection of information are estimated to average 2 hours per outfall. Send comments on the Agency's need for this information, the accuracy of the provided burden estimates and any suggested methods for minimizing respondent burden to the Regulatory Support Division Director, U.S. Environmental Protection Agency (2821T), 1200 Pennsylvania Ave., NW, Washington, D.C. 20460. Include the OMB control number in any correspondence. Do not send the completed form to this address.

Permit

Permit #:	IL0022209	Permittee:	KNOXVILLE, CITY OF	Facility:	KNOXVILLE STP, CITY OF
Major:	No	Permittee Address:	33 NORTH SIDE PUBLIC SQUARE KNOXVILLE, IL 61448	Facility Location:	507 SOUTH DIVISION STREET KNOXVILLE, IL 61448
Permitted Feature:	INF Influent Structure	Discharge:	INF-L INFLUENT MONITORING		

Report Dates & Status

Monitoring Period:	From 10/01/26 to 10/31/26	DMR Due Date:	11/25/26	Status:	NetDMR Validated

Considerations for Form Completion

BOW ID: W0950300002

Principal Executive Officer

First Name:	Ty	Title:	Chief Operator	Telephone:	309-854-3520
Last Name:	Cruse				

No Data Indicator (NODI)

Form NODI: –

Parameter Code	Parameter Name	Monitoring Location	Season #	Param. NODI		Quantity or Loading Qualifier 1	Value 1	Qualifier 2	Value 2	Units	Quality or Concentration Qualifier 1	Value 1	Qualifier 2	Value 2	Qualifier 3	Value 3	Units	# of Ex.	Frequency of Analysis	Sample Type
00310	BOD, 5-day, 20 deg. C	G - Raw Sewage Influent	0	--	Sample								=	195.0			19 - mg/L		09/99 - See Permit	CP - Composite
					Permit Req.									Req Mon MO AVG			19 - mg/L	0	09/99 - See Permit	CP - Composite
					Value NODI															
00530	Solids, total suspended	G - Raw Sewage Influent	0	--	Sample								=	38.7			19 - mg/L		09/99 - See Permit	CP - Composite
					Permit Req.									Req Mon MO AVG			19 - mg/L	0	09/99 - See Permit	CP - Composite
					Value NODI															
50050	Flow, in conduit or thru treatment plant	G - Raw Sewage Influent	0	--	Sample	=	0.522552	=	1.6048	03 - MGD									99/99 - Continuous	
					Permit Req.		Req Mon MO AVG		Req Mon DAILY MX	03 - MGD								0	99/99 - Continuous	
					Value NODI															

Submission Note

If a parameter row does not contain any values for the Sample nor Effluent Trading, then none of the following fields will be submitted for that row: Units, Number of Excursions, Frequency of Analysis, and Sample Type.

Edit Check Errors

No errors.

Comments

Attachments

No attachments.

Report Last Saved By

KNOXVILLE, CITY OF

User:	RYANTY243
Name:	Ty Cruse
E-Mail:	tyc24380@gmail.com
Date/Time:	2026-11-09 15:41 (Time Zone: -06:00)

Report Last Signed By

User:	RYANTY243
Name:	Ty Cruse
E-Mail:	tyc24380@gmail.com